



GUIDANCE NOTE B05

FIRE SAFETY

Revised – December 2022

ARMA Standards

The Standards have been written to apply to residential long leasehold properties (a lease of a term in excess of 21 years when originally granted) in England and Wales where a service charge, which varies according to expenditure, is payable.

They represent the core of good practice for managing agents. We believe they are achievable by any well-run company. The applicable (if any) Standards related to this Guidance Note are stated below.

Standards in RED: An obligation to adhere to the Standard

Standards in GREEN: An obligation to adhere to the Standard unless there is a justifiable reason not to comply that the Managing Agent must be able to demonstrate

6.2 Statutory compliance

The managing agent must have regard to and comply with:

- f) relevant legislation to ensure the health and safety of employees;
- g) obligations under the regulations regarding fire safety;
- h) health and safety regulations relating to buildings under their management including but not limited to water and asbestos;
- i) all other relevant legislation.

Introduction

This Guidance Note (GN) has been produced by the ASSOCIATION OF RESIDENTIAL MANAGING AGENTS (ARMA) in line with statutory guidance and industry best practice and independently reviewed by ARMA's Primary Authority Partner, Hampshire & Isle of Wight Fire and Rescue Service.

It represents the core of good practice for managing agents and the clients/responsible persons who they act for.

While every effort has been made to ensure the accuracy of the information contained in this GN, it must be emphasised that because the Association and Hampshire & Isle of Wight Fire and Rescue Service have no control over the precise circumstances in which it will be used, the Association, its officers, employees and members and Hampshire & Isle of Wight Fire and Rescue Service can accept no liability arising out of its use, whether by members of the Association or otherwise. The GN is of a general nature only and makes no attempt to state or conform to legal requirements; compliance with these must be the individual user's own responsibility and therefore should seek independent advice.

2	Overview	49	Primary Authority Scheme
3	PART 1 - FIRE SAFETY LAW	50	Further information
3	The law governing fire safety in blocks of flats	53	Annex A - Examples of fire action notices
3	The Fire Safety Act 2021	55	Annex B - Advice on the scope of a FRA
3	The Building Safety Act 2022	57	Annex C - Fire Design Standards
3	The Regulatory Reform (Fire Safety) Order 2005	58	Annex D - The History of the Building Regulations
5	The Fire Safety (England) Regulations 2022		
6	The Responsible Person		
8	Managing Agent's responsibilities		
10	Fire Safety Assistance		
11	PART 2 - FIRE RISK ASSESSMENT		
11	Fire risk assessments		
18	Fire risk action plans		
19	PART 3 - FIRE SAFETY MANAGEMENT		
19	Fire strategies		
19	The fire strategy		
24	Evacuation strategy		
26	Fire risk management strategy		
27	Fire safety information		
29	Fire safety arrangements		
33	PART 4 - MANAGING FIRE RISKS		
33	Emergency routes and exits		
33	Fire detection and alarm systems		
34	Compartmentation and flat front doors		
37	Wayfinding signage		
37	Electric vehicle charging		
38	Housekeeping and common parts		
40	Routine checks and maintenance		
47	Secure information box		
48	Providing information to residents		

Overview

This guidance sets out the key requirements for managing fire safety in multi-occupied residential buildings. It has been updated to take account of the requirements of the Fire Safety Act 2021 and the Fire Safety (England) Regulations 2022. It is not in any way a full statement of what a managing agent should be aware of in respect of fire safety. It also signposts to guidance on best practice where this is available.

PART 1 – FIRE SAFETY LAW

The law governing fire safety in blocks of flats

The following legislation imposes duties in relation to fire safety in blocks of flats:

- The Fire Safety Act 2021¹;
- The Building Safety Act 2022²;
- The Regulatory Reform (Fire Safety) Order 2005³ (as amended by the Fire Safety Act 2021);
- The Fire Safety (England) Regulations 2022⁴;
- The Building Regulations 2010⁵ (as amended) [the Building Regulations]; and
- The Housing Act 2004⁶.

The Fire Safety Act 2021

The Fire Safety Act 2021¹ was brought into force by the Fire Safety Act 2021 (Commencement) (England) Regulations 2022 on 16th May 2022.

The Fire Safety Act 2021 amends the Regulatory Reform (Fire Safety) Order 2005 to widen its scope to include:

Where a building contains two or more sets of domestic premises:

- *the building's structure and external walls and any common parts;*
- *all doors between the domestic premises and common parts.*

Reference to external walls includes:

- doors or windows in those walls; and
- anything attached to the exterior of those walls (including balconies).

The Act also requires the Secretary of State to publish risk-based guidance which sets out how a person who is subject to the duties in relation to more than one set of premises is to prioritise the discharge of those duties in respect of the different premises by reference to risk.

The Fire Safety Act Commencement Prioritisation Guidance⁸ was issued by the Secretary of State in May 2022.

The Prioritisation Guidance, in particular, explains the Government's FRA Prioritisation Tool⁹ which has been created to allow responsible persons to identify when their building's fire risk assessment (FRA) should be reviewed.

Further details about the Prioritisation Guidance and the FRA Prioritisation Tool can be found in the part of this guide covering [Fire Risk Assessment](#).

The Building Safety Act 2022

The Building Safety Act 2022² received Royal Assent on 28th April 2022.

Part 4 of the Act is about occupied higher-risk buildings in England, and imposes duties on accountable persons, who will be the new duty holders in such buildings, in relation to the assessment and management of building safety risk, which is defined as:

- the spread of fire;
- structural failure.

The date for the commencement of Part 4, and much of the detailed requirements, will be set out in Secondary Legislation, which is being consulted on.

The Regulatory Reform (Fire Safety) Order 2005

Application of the Order

The Regulatory Reform (Fire Safety) Order 2005³ (hereafter the Fire Safety Order or FSO) applies to premises which are defined as 'any place' and in particular includes any workplace.

The Fire Safety Order ‘does not apply in relation to domestic premises, except to the extent mentioned in paragraph (1A) or article 31(10)’.

Paragraph (1A) states:

‘Where a building contains two or more sets of domestic premises, the things to which this order applies include:

- (a) the building’s structure and external walls and any common parts;*
- (b) all doors between the domestic premises and common parts (so far as not falling within sub-paragraph (a)).’*

Paragraph (1B) states:

‘The reference to external walls includes:

- (a) doors or windows in those walls, and*
- (b) anything attached to the exterior of those walls (including balconies).’*

Article 31(10) allows an enforcing authority to prohibit the use of a property in certain circumstances.

Duties imposed by the Fire Safety Order

The Fire Safety Order requires the responsible person in a purpose-built block of flats to:

- take such general fire precautions as will ensure, so far as is reasonably practicable, the safety of any employees and that the premises are safe for relevant persons ([Article 8](#));
- make a suitable and sufficient assessment of the risks to which any persons are exposed (i.e. any person who is or may be lawfully on the premises and any person in the immediate vicinity of the premises who is at risk from a fire on the premises), for the purpose of identifying the general fire precautions which include the measures required:
 - o to reduce the risk of fire and the risk of the spread of fire on the premises;
 - o to provide the means of escape from the premises;
 - o to ensure that the means of escape can be safely and effectively used at all times;
 - o for fighting fires on the premises;
 - o for detecting fire on the premises and giving warning in case of fire on the premises; and
 - o for action to be taken in the event of fire on the premises, including the instruction and training of employees and the mitigation of the effects of the fire ([Article 9](#)).
- When implementing any preventive and protective measures, do so on the basis of the following principles:
 - o avoid risks;
 - o evaluate the risks which cannot be avoided;
 - o combat the risks at source;
 - o adapt to technical progress;
 - o replace the dangerous by the non-dangerous or less dangerous;
 - o develop a coherent overall prevention policy which covers technology, organisation of work and the influence of factors relating to the working environment;
 - o give collective protective measures priority over individual protective measures; and
 - o give appropriate instructions to employees. ([Article 10](#));
- make, give effect to and record (if they employ five or more employees) such arrangements as are appropriate, for the effective planning, organisation, control, monitoring and review of the measures which have been identified in the risk assessment as the general fire precautions needed to be taken to comply with the Order (the preventive and protective measures) ([Article 11](#));
- where necessary in order to safeguard the safety of relevant persons:
 - o ensure that the premises are, to the extent that it is appropriate, equipped with appropriate firefighting equipment and with fire detectors and alarms; ([Article 13](#)); and

-
- o ensure that routes to emergency exits from premises and the exits themselves are kept clear at all times ([Article 14](#));
 - establish and, where necessary, give effect to appropriate procedures, including safety drills, to be followed in the event of serious and imminent danger to relevant persons ([Article 15](#));
 - ensure that the premises and any facilities, equipment and devices provided in respect of the premises under this Order are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair ([Article 17](#));
 - appoint one or more competent persons to assist in undertaking preventive and protective measures ([Article 18](#));
 - provide their employees with comprehensible and relevant information on the risks to them identified by the risk assessment and the preventive and protective measures and adequate training ([Article 19](#)).

The Fire Safety (England) Regulations 2022

The Fire Safety (England) Regulations 2022⁴ were introduced on 18th May 2022 under Article 24 of the Fire Safety Order to implement the majority of the recommendations made to government in the Grenfell Tower Inquiry Phase 1 report and come into force on 23rd January 2023.

There are duties for all multi-occupied residential buildings with two or more sets of domestic premises, with additional duties for those over 11 metres and 18 metres (or has at least seven storeys). The term 'high-rise residential buildings' is defined as:

- being at least 18 metres above ground level; or
- having at least seven storeys.

Domestic premises means premises occupied as a private dwelling (including any garden, yard, garage, outhouse, or other appurtenance of such premises which is not used in common by the occupants of more than one such dwelling).

The height of a building is to be measured to the height to the top storey in accordance with Appendix D to Approved Document B.

When determining the number of storeys a building has:

- any storey which is below ground level is to be ignored;
- any mezzanine floor is a storey if its internal floor area is at least 50% of the internal floor area of the largest storey in the building which is not below ground level; and
- a storey is treated as below ground level if any part of the finished surface of the ceiling of the storey is below the ground level immediately adjacent to that part of the building.

Duties imposed by the Fire Safety (England) Regulations

In 'high-rise residential buildings', responsible persons will be required to:

- provide their local Fire and Rescue Service (FRS) with:
 - o up-to-date electronic building floor plans;
 - o information about the design and materials of a high-rise building's external wall system and inform the FRS of any material changes to these walls; and
 - o information in relation to the level of risk that the design and materials of the external wall structure gives rise to and any mitigating steps taken;
- install and maintain a secure information box in their building which must contain:
 - o the name and contact details of the responsible person;
 - o hard copies of the building floor plans; and
 - o a single-page building plan which identifies key firefighting equipment;
- undertake monthly checks on the operation of:
 - o lifts intended for use by firefighters;
 - o evacuation lifts; and
 - o essential firefighting equipment;

- report any defective lifts or essential firefighting equipment to their local FRS if the fault cannot be fixed within 24 hours, and record the outcome of checks and make them available to residents; and
- install signage visible in low light or smoky conditions that identifies flat and floor numbers in the stairwells of relevant buildings.

In residential buildings with storeys over 11 metres in height, responsible persons will be required to:

- use best endeavours to undertake annual checks of flat entrance doors; and
- undertake quarterly checks of all fire doors in the common parts.

In all multi-occupied residential buildings with two or more sets of domestic premises, responsible persons will be required to:

- provide relevant fire safety instructions to their residents, which will include:
 - o instructions on how to report a fire; and
 - o any other instruction which sets out what a resident must do once a fire has occurred, based on the evacuation strategy for the building; and
- provide residents with information relating to the importance of fire doors in fire safety.

The responsible person

In the FSO, there is a hierarchy of responsible persons. The definition of responsible persons is in Article 3, where the hierarchy of responsible persons is set out as follows:

- (a) *in relation to a workplace, the employer, if the workplace is to any extent under his/her control;*
- (b) *in relation to any other premises:*
 - (i) *the person who has control of the premises (as occupier or otherwise) in connection with the carrying on by him/her of a trade, business or other undertaking (for profit or not); or*
 - (ii) *the owner, where the person in control of the premises does not have control in connection with the carrying on by that person of a trade, business or other undertaking.*

Responsible person in workplaces

Where the parts of the building that need to be managed are a workplace, Article 3(a) applies.

The hierarchy in the definition in Article 3 means that employers are retained as the persons with primary responsibility in workplaces.

The FSO defines a workplace as:

any premises or parts of premises, not being domestic premises, used for the purposes of an employer's undertaking which are made available to an employee of the employer as a place of work and includes:

- (a) *any place within the premises to which such employee has access while at work; and*
- (b) *any room, lobby, corridor, staircase, road, or other place:*
 - (i) *used as a means of access to or egress from that place of work; or*
 - (ii) *where facilities are provided for use in connection with that place of work, other than a public road.*

Therefore, where the person or organisation named in the lease as being responsible for the maintenance, repair and cleaning of the common parts is an employer and makes those common parts available to their employees, they will be a responsible person.

Where a managing agent is responsible for managing a property and they employ a property manager, or concierge, whose workplace is the property, or a place within the property, they could be considered the responsible person for the workplace if it is, to any extent, under their control. In such circumstances responsibility will extend to any room, lobby, corridor, staircase, road, or other place:

-
- used as a means of access to or egress from that place of work; or
 - where facilities are provided for use in connection with that place of work.

The ability for a managing agent to instruct work without referring the matter to their client for approval and their agreed spending limit or emergency spending provision will all be relevant in determining the limit of their control and therefore the extent of their duties as a responsible person.

Responsible person for parts of the building that are not a workplace

Where the parts of the building that need to be managed are not a workplace, Article 3(b) applies.

This is the case:

- where the parts to be managed are:
 - o the building's structure and external walls; and
 - o doors between the domestic premises and common parts; or
- where the common parts are controlled by an organisation, or person, that is not an employer that makes those common parts available to their employees.

The responsible person in such circumstances is therefore:

- the person who has control of the premises (as occupier or otherwise) in connection with the carrying on by him/her of a trade, business or other undertaking (for profit or not); or
- the owner, where the person in control of the premises does not have control in connection with the carrying on by that person of a trade, business or other undertaking.

This means that the responsible person for the building's structure and external walls; and doors between the domestic premises (and anything affixed to them) and common parts, can be:

- the person or organisation who is named in the lease as being responsible for the maintenance, repair and cleaning of those parts e.g. landlord, residents management company (RMC), or managing agent as the named manager in a tripartite lease, or a right to manage company (RTM) who has acquired the right to manage under the provisions of the Commonhold and Leasehold Reform Act or a court or tribunal appointed manager (appointed under section 24 of the Landlord and Tenant Act 1987);
- a managing agent where:
 - o their management agreement commits them to discharging a duty under the Fire Safety Order; and
 - o they have an ability to instruct work without referring the matter to their client for approval and could have discharged the duty within the agreed spending limit or under an emergency spending provision; or
- a leaseholder (flat owner) where parts of the building to which the FSO applies are demised to them.

In some cases, the person or organisation named in the lease as being responsible for the building's structure and external walls is different from the person or organisation who is named as being responsible for the common parts. In such cases they will both be a responsible person, as well as any leaseholders where parts of the building to which the FSO applies are demised to them.

Responsible persons in tripartite leases

A managing agent will be a responsible person where they are named in the lease as being responsible for the management of any part of the building that falls within the scope of the FSO. This would be the case where they are named as being responsible for the management function within a tripartite lease.

Managing agents as a responsible person

Even where the managing agent is, or could be considered, the responsible person they:

- should only take the action where :
 - o it can be undertaken within their agreed spending limit;
 - o the lease permits; and
 - o the costs for taking the action are recoverable and reasonable; or/and
- should not take action where they have been explicitly instructed by their client not to do so.

Determining who is the responsible person in a residential leasehold property

The provisions of the building's lease will usually determine who is a responsible person. There will, in many cases, be more than one responsible person. A freeholder, landlord, RMC, RTM and even, in certain circumstances, a residential managing agents (hereafter referred to as managing agents) can all be a responsible person.

The leaseholder, where parts of the building to which the FSO applies are demised to them, may also be a responsible person in relation to the demised parts.

If you are in any doubt as to who is, or who is not, a responsible person, or you are receiving conflicting opinion, you should seek further professional guidance.

When commissioning FRAs, managing agents are advised to consult the lease to determine who the responsible person is, or responsible persons are, and ensure that the names of all responsible persons and the parts of the building they are responsible for are communicated to the risk assessor and recorded in the risk assessment.

Where parts of the building to which the FSO applies, such as flat front doors and balconies, are demised to leaseholders, this should be communicated to the risk assessor and recorded in the risk assessment; however, it is not perhaps necessary to name each leaseholder.

Managing agents' responsibilities

Other people and organisations also have duties under the Order. [Article 5\(3\)](#) states that:

'Any duty imposed by articles 8 to 22 ... on the responsible person in respect of premises shall also be imposed on every person, other than the responsible person ... who has, to any extent, control of those premises so far as the requirements relate to matters within his/her control.'

[Article 5\(4\)](#) states that:

'Where a person has, by virtue of any contract or tenancy, an obligation of any extent in relation to:

- (a) the maintenance or repair of any premises, including anything in or on premises; or*
- (b) the safety of any premises;*

that person is to be treated as being a person who has control of the premises to the extent that his/her obligation so extends.'

Article 5(3) and 5(4) can impose duties on a wide variety of people, including the managing agent, fire risk assessors, fire alarm maintenance contractors and in the case of flat front doors, the leaseholder.

A managing agent will have duties under the Fire Safety Order only where they have agreed to undertake duties in relation to compliance with the Fire Safety Order on behalf of their client. Any such agreement should be recorded in their management agreement.

Where a managing agent uses the latest revision of the ARMA model management agreement, they are required to advise their client on all relevant legislative and regulatory issues, including advice on the actions that the responsible person will need to take to comply with the requirements of the Fire Safety Order, but have a choice as to whether they will offer additional services in relation to fire safety management.

If a managing agent fails to provide such advice, they may be considered to have breached Article 5(3) and 5(4), particularly if their failure resulted in their client failing to comply with the requirements of the Fire Safety Order.

Where a managing agent chooses to offer fire safety management services, Article 5(3) and 5(4) imposes duties upon them in relation to the services they offer. They will not, however, automatically become the responsible person. Where a managing agent has:

- agreed to manage, on behalf of their client, any aspect of fire safety that falls within the scope of the Fire Safety Order; and
- a right to go ahead with works up to an agreed expenditure limit without reference to their client;

they will almost certainly be deemed to have duties under Article 5(3) and 5(4) and will have breached these duties if they fail to undertake a duty that could be executed within the limit of their authority.

It is therefore very important for managing agents to be clear with their client about the fire safety management services they offer and ensure that any agreement is clearly recorded in the service-level agreement.

Section 20

Section 20 (S20) is a clause in the Landlord and Tenant Act 1985⁷ intended to protect leaseholders from paying unnecessarily large sums for work carried out to their building. In summary it says that a leaseholder's contribution to the cost of work will be capped if the landlord or their agent fails to follow set consultation procedures first.

RMCs and RTMs are included under the definition of a landlord for the purposes of S20.

S20 procedures apply to work, including work required under the Fire Safety Order and other fire safety legislation, carried out by RMCs, RTMs or other landlords/freeholders. The procedure is prescribed in detailed regulations issued by the government. Failure to follow the procedure can result in penalties.

If you do not consult properly, you will be subject to a penalty: the maximum costs leaseholders can be made to pay for the work will be limited to £250. This is regardless of the final bill.

An S20 consultation must be carried out if any one leaseholder's contribution to the work is estimated to, or does, exceed £250. When calculating the estimated cost, VAT and any consultants' fees must be included.

For stages one and two of the process, leaseholders must be given at least 30 days to reply with any comments. Even if estimates can be obtained quickly, it will take at least two to three months as a minimum.

The First-tier Tribunal (Property Chamber) in England or the Leasehold Valuation Tribunal in Wales can dispense with S20 rules before or after works have been carried out, but only if a good case can be made.

For more information, please see ARMA Advice Note Section 20 Consultation and Major Works.

Cooperation and coordination

Where two or more responsible persons share, or have duties under the Fire Safety Order in respect of premises, Article 22 of the Order requires each such person to:

- cooperate with the other responsible persons concerned so far as is necessary to enable them to comply with their duties under the Fire Safety Order;
- take all reasonable steps to co-ordinate the measures each responsible person needs to take to comply with the Fire Safety Order; and
- take all reasonable steps to inform the other responsible persons of any risks to relevant persons associated with areas of the building for which they are responsible.

Fire Safety Assistance

Article 18 of the Fire Safety Order requires the responsible person to appoint one or more competent persons to assist them in undertaking the preventive and protective measures.

Where a managing agent:

- is required by their management agreement to provide advice on legal requirements and the management of a building, as is usually the case, or
 - is undertaking any duties of the responsible person on behalf of their client;
- there is an expectation that they should themselves appoint one or more competent persons to assist them in discharging their duties and responsibilities.

Managing agents should always make their client (the responsible person) aware of their need for competent advice and where they are not in a position to provide that advice, provide the necessary advice and assistance on the appointment of a suitable person or organisation.

A fire safety adviser should be able to provide:

- advice on the systems that need to be put in place to effectively manage fire safety within company offices and the properties they manage;
- property managers with expert advice on fire safety management issues in the properties they manage; and
- challenge the findings of an FRA where either the property manager has concerns or the findings are disputed by the responsible person.

A person is to be regarded as competent for the purposes of Article 18 where they have sufficient training and experience or knowledge and other qualities to enable him/her to assist in undertaking the preventive and protective measures.

Members or Fellows of the following organisations may make suitable fire advisers:

- The Institute of Fire Safety Managers²⁸;
- The Institute of Fire Prevention Officers²⁹;
- The Institution of Fire Engineers³⁰.

Members of these organisations will all have been assessed by the professional body as having suitable levels of education and experience in fire safety. You will however need to check that the individual you wish to engage has appropriate experience of the long leasehold sector and the types of buildings that you manage.

Fire safety advice may be provided by an external consultancy service or by inhouse staff providing they meet the required competent standards.

There is no legal requirement for an organisation's fire safety adviser to come from a different company to the company that undertakes risk assessments. However, delivery of the two roles by separate organisations allows:

- independent advice to be obtained about the scope and frequency of assessments; and
- the findings of risk assessments, where necessary, to be challenged by somebody with appropriate skills, knowledge, experience and behaviours.

PART 2 – FIRE RISK ASSESSMENT

Fire risk assessments

The FSO requires the responsible person to make a suitable and sufficient assessment of the risks to which relevant persons are exposed for the purpose of identifying the general fire precautions they need to take to comply with the requirements and prohibitions imposed on them by or under the FSO.

Where a building contains two or more sets of domestic premises, the FRA also needs to consider:

- the building's structure and external walls including:
 - o doors or windows in external walls; and
 - o anything attached to the exterior of external walls (including balconies);
- any common parts; and
- all doors between the domestic premises and common parts.

The responsibility to arrange for the FRA to be undertaken, and to action its findings where required, lies with the responsible person.

Where two or more responsible persons share, or have duties in respect of, premises it is appropriate for:

- one FRA to be commissioned on behalf of all responsible persons; and
- where this is not practicable, for each responsible person, to:
 - o share the findings of their FRA with all other responsible persons; and
 - o to update their own risk assessment to take into account relevant information provided in the FRAs provided by the other responsible persons.

If the blocks of flats have no FRA, or where the FRA is out of date or otherwise deemed to be unsuitable, a managing agent should advise their client/the responsible person to have an FRA carried out at once.

Where a managing agent's service-level agreement requires them to manage fire safety on behalf of the client and/or engage a company to undertake an FRA or similar relevant requirement and authorisation to do so is refused, they should consider resigning.

Completion and review of the FRA is a statutory duty under the Fire Safety Order, and advising the responsible person that one is needed may not alone provide a managing agent with sufficient defence if the matter is investigated by the fire service and goes to the courts for jurisdiction.

Resignation should of course be a last resort and then only once a managing agent has exhausted all avenues to persuade the responsible person to take the appropriate action.

Risk-based guidance

Article 50 of the Fire Safety Order requires the Secretary of State to ensure that such guidance, as s/he considers appropriate, is available to assist responsible persons in the discharge of the duties imposed by Articles 8 to 22 and by regulations made under Article 24.

The Fire Safety Act amends Article 50 to allow:

- proof of a failure to comply with any applicable risk-based guidance as tending to establish that there was such a contravention of Articles 8 to 22 and by regulations made under Article 24; and
- proof of compliance with any applicable risk-based guidance as tending to establish that there was no such contravention.

Risk-based guidance is defined in the amended Article 50 as guidance about how a person who is subject to the duties mentioned there in relation to more than one set of premises is to prioritise the discharge of those duties in respect of the different premises by reference to risk.

The Fire Safety Act Commencement Prioritisation Guidance⁸ was issued by the Secretary of State in May 2022, in accordance with Article 50, and is intended to be used by responsible persons, or anyone who has, to any extent, control of buildings with two or more sets of domestic premises, to enable them to comply with their duties under the Fire Safety Order, further to the amendments made by the Fire Safety Act 2021.

This guidance is provided to support responsible persons to develop a strategy to prioritise their buildings to update their FRAs to include external walls. There is no legal requirement to follow this guidance. However, a court can consider whether a responsible person has complied (or not) with their duties under the Fire Safety Order by following this guidance.

Reviewing FRA to cover Section 1 of the Fire Safety Act

Before commissioning the review of an FRA to cover Section 1 of the Fire Safety Act 2022, the responsible persons, and anyone involved in the commissioning of the review, are advised to read the Home Office's Fire Safety Act Commencement Prioritisation Guidance.

The Home Office guidance, in particular, explains the Government's FRA Prioritisation Tool⁹ which has been created to allow responsible persons to identify when their building's FRA should be reviewed. The online tool takes responsible persons through a series of specific questions to assist them in determining the priority of their buildings for the purpose of reviewing their FRAs. The tool does this by allocating each building to one of five priority tiers.

Tier	Priority	FRA review
1	Very high priority	Without delay
2	High priority	As soon as practically possible
3	Medium priority	When they are able to do so, reflecting the availability of competent fire safety professionals
4	Low priority	May wish to bring forward reviewing their FRA
5	Very low priority	Should consider the new duties in the FSO when they next review their FRA

The Prioritisation Guidance states that use of the FRA Prioritisation Tool, together with the Fire Safety Act Commencement Prioritisation Guidance, will be beneficial to responsible persons to show due diligence, and assist in establishing in any proceedings, that they are meeting their obligations under the FSO (as amended by the Fire Safety Act 2021).

The tool asks responsible persons key information about the building that should be gathered before completing the questions. This includes:

- the height of the building (in storeys);
- if known, the composition of the external wall and covering materials (if relevant);
- the most recent FRA;
- whether there are balconies and the composition of windows;
- number of staircases;
- details of whether the building has been recently refurbished;
- the type of evacuation strategy in place;
- whether the building has fire safety systems, like sprinklers or communal fire alarms;
- whether vulnerable residents live in the building; and
- details of whether there have been any recent fires or serious antisocial behaviour.

Appointing fire risk assessors

No matter who carries out an FRA, responsible persons retain responsibility for ensuring that the assessment fulfils the requirements of the law.

To demonstrate that both they and the responsible person have taken reasonable steps to comply with their duties, managing agents must, when they have agreed to commission an FRA on behalf of a responsible person, make reasonable checks to ensure that those who undertake the assessment are competent to properly do the work.

The NFCC has published guidance on FRAs¹⁷. The guidance provides details of the steps and precautions that can be taken to help verify the competence and suitability of a prospective FRA.

The NFCC guidance provides a link to the Fire Sector Federation's Approved Code of Practice [CoP] for Fire Risk Assessor Competency²⁵. This CoP was developed by a working group established under a joint fire and construction industry initiative following the Grenfell Tower fire of 14th June 2017. The CoP states that accredited third-party certification is judged essential for fire risk assessors, particularly those working on high risk-buildings.

Competence of fire risk assessors can be assured by either certification of the individual fire risk assessor or through a company providing FRAs under a third-party certification scheme accredited by the UK Accreditation Service (UKAS)³², or by registration of the fire risk assessor by a Professional Engineering Institution³³ that is licensed by the Engineering Council (EngC)³⁴.

Details of UKAS-accredited and/or professional body registers can be found in Appendix 1 of the Fire Sector Federation's A Guide to Choosing a Competent Fire Risk Assessor²⁶.

Managing agents are advised to:

- follow the guidance on selecting a suitable fire risk assessor given by the NFCC in their guidance on FRAs; and
- ensure that the competence of risk assessors has been assured by third-party certification as set out in the Fire Sector Federation's CoP.

Specifying the scope of a risk assessment

It is essential that managing agents, when procuring an FRA:

- agree the scope of the risk assessment with the responsible person; and
- provide those who are being requested to quote with a written copy of the scope.

The scope:

- must include the name and contact detail(s) of the responsible person(s) on whose behalf the assessment is being instructed;
- should, where the risk assessment is being instructed by a managing agent on behalf of the responsible person(s), include details of what fire safety management functions the managing agent has agreed within their management agreement to undertake on behalf of the responsible person(s) and any limits on their authority such as spending limits;
- must list all parts of the property that falls within the scope of the Fire Safety Order and under the control of the named responsible person(s) that must be considered in the assessment;
- must set out the type of assessment required (a Type 1 assessment is advised unless available information about the building or known risks dictates that a more detailed assessment is required); and
- should make it a specific requirement that the assessor:
 - o assesses the available information and the building to determine whether they have sufficient information to understand the fire strategy (see the ARMA guidance for a definition) for the building;

- o where they can identify the fire strategy, ensures that the fire strategy is referenced or documented;
- o considers the requirements of recent or forthcoming fire safety legislation and/or government and FRS guidance that applies or will apply to the property, and advises on actions that are or will be required to comply with the legislation and guidance;
- o advises on whether a more detailed risk assessment (Types 2 to 4 or specialist assessment of a key risk such as cladding or compartmentation) is required to satisfy the requirement to make 'a suitable and sufficient assessment of the risks to which relevant persons are exposed' or comply with recent or forthcoming fire safety legislation and/or Government and FRS services guidance;
- o includes within the assessment a time-bound action plan for any actions that are required to comply with the requirements of current legislation;
- o agrees the timeframes for any actions with the responsible person before completing the assessment report;
- o includes a detailed list of any areas or parts of the building excluded from the assessment; and
- o includes within the assessment record details about the responsible person(s) and, where appropriate details of the managing agent who instructed the assessment.

It is important that the fire risk assessor understands what fire safety management functions the managing agent has agreed within their management agreement to undertake on behalf of the responsible person(s) and any limits on their authority such as spending limits. Including such information within the FRA report may assist FRS authorities to correctly identify the limits of a managing agent's duties and responsibilities when taking action, particularly when they are limited by the management agreement, and ensure that any enforcement action is taken against the correct parties.

The legal duty is for the responsible person to make 'a suitable and sufficient assessment of the risks to which relevant persons are exposed for the purpose of identifying the general fire precautions [s/]he needs to take to comply with the requirements and prohibitions imposed on [her/]him by or under this Order.'

Relevant persons are:

- any person who is or may be lawfully on the premises; and
- any person in the immediate vicinity of the premises who is at risk from a fire on the premises.

The FRA must consider the risks to which relevant persons are exposed for the purpose of identifying the general fire precautions that need to take to comply with the requirements and prohibitions imposed by or under the FSO that are associated with:

- the building's structure and external walls including:
 - o doors or windows in external walls; and
 - o anything attached to the exterior of external walls (including balconies);
- the common parts and all elements of the structure which protect the common parts including all doors between the domestic premises and common parts irrespective of who they are demised to;
- elements of the structure which provide or protect the means of escape;
- measures for fighting and where appropriate detecting fire; and
- arrangements for action to be taken in the event of fire on the premises.

There are, in principle, four different types of FRA that can be carried out for a purpose-built block of flats. They differ in the extent to which the building is inspected.

Details of the different types of assessment can be found in [Annex B](#) of this GN.

It is essential when instructing any type of FRA that you are clear about the scope of the assessment and the responsible person's expected outcomes.

You should, wherever possible specify the type of assessment required.

FRA Standards

Although it will normally be the fire risk assessor that will determine the FRA methodology, when instructing an FRA, a managing agent should ensure that the methodology follows an acceptable standard. Current best practice is set out in PAS 79-2 – Fire Risk Assessment – Part 2: Housing – Code of practice³⁶.

Following the publication of PAS 79-2, the British Standards Institution (BSI) received a complaint regarding the text of in relation to evacuation of disabled people from blocks of flats. The BSI suspended and have subsequently permanently withdrawn PAS 79-2 pending conversion of the PAS into a full British Standard. The Fire Industry Association and the Institute of Fire Safety Managers objected to the withdrawal and recommended that it was restored for sale. The BSI have issued a Technical Bulletin on the status of PAS 79-2 which indicates that they strongly support the use of the downloadable version of PAS 79-2 for guidance and recommendations on carrying out FRAs for housing premises.

When conducting a Fire Risk Appraisal of the External Wall (FRAEW), current best practice is set out in PAS 9980:2022, Fire risk appraisal and assessment of external wall construction of existing blocks of flats – Code of practice⁵⁴.

A FRAEW, when required, is part of the overall FRA for a building. It should inform the assessment of risk and any required remedial action. It should also form part of the documented risk assessment.

Provision of information to assessors

It is essential that the responsible person, or the managing agent when their management agreement includes the commissioning of FRAs, provides a risk assessor with any information they may require to undertake the assessment. Information will include:

- the names of all responsible persons* and the areas of the premises that they are responsible for;
- details of what, in relation to fire safety management, they have, as managing agent, agreed in their management agreement to do on behalf of the responsible person(s);
- details of number and types of occupants in the premises;
- a copy of the previous FRA;
- details of any fires that have occurred since the last assessment;
- details of any enforcement action or alterations notices issued by a fire enforcement authority;
- details of any building work undertaken since the last inspection to which the Building Regulations apply along with any completion certificates;
- the evacuation procedures and any emergency plans;
- any arrangements that are in place for the safety of those who are unable to self-evacuate who may be present in the premises in the event of an emergency;
- the fire safety information required in accordance with Regulation 38 of the Building Regulations, including:
 - o the as-built fire strategy;
 - o plans detailing compartmentation and other passive fire safety measures;
 - o installation information, commissioning and maintenance, inspection and test requirements for the active fire systems;
 - o details of any active fire safety measures; and
 - o details of fire detection provided/installed in flats
- copies of any external wall surveys including completed EWS1 Forms⁶⁴ for the premises;
- evidence of inspection, testing and maintenance of:
 - o installed fire safety and smoke control systems (see section covering testing and maintenance for a list of systems that need to be inspected, tested and maintained);
 - o fixed electrical systems;
 - o portable electrical equipment;

-
- o gas appliances and fittings; and
 - o lightning protection installations;
 - the arrangements for action to be taken in the event of fire on the premises, including details of any:
 - o instruction and training of employees; and
 - o measures taken to mitigate the effects of the fire;
 - the arrangements for the effective planning, organisation, control, monitoring and review of the preventive and protective measures;
 - any other policies and procedures in place such as smoking, arson prevention, business continuity, visitor’s signing-in book and fire action plans;
 - the access arrangement to flats to facilitate inspection of the flat front doors; and
 - where relevant, dangerous substances and explosive atmosphere regulations [DSEAR] assessments.

* Where parts of the building to which the FSO applies, such as flat front doors and balconies, are demised to leaseholders, this should be communicated to the risk assessor and recorded in the risk assessment noted; however, it is perhaps not necessary to name each leaseholder.

Purpose-built blocks of flats are usually designed in accordance with Approved Document B Volume 1³ or BS 9991:2015⁵⁶. Fire engineering principles can apply to support alternative solutions where strict adherence to the codes may conflict with wider aspirations for the scheme through the application of BS 7974:2019⁴⁷ Parts 1 to 7. Details of the code being used and any variations from code compliance should be documented in the fire strategy.

It is therefore essential that the person employed to undertake an FRA is in possession of the fire strategy for the building and is familiar with the fire safety design standards used to design the building.

Where a managing agent does not have relevant information, it is essential that they try to obtain this.

Where the information cannot be found or does not exist, it may be necessary to commission a competent person with the necessary professional indemnity insurance to undertake the necessary investigations and prepare the required information.

Managing agents responsibilities in relation to FRAs

When instructing an FRA, managing agents must make the fire risk assessor aware, ideally in writing, either in the scope or their instruction to the assessor, of what, in relation to fire safety management, they have agreed in their management agreement to do on behalf of the responsible person(s).

The ARMA model management agreement provides managing agents who are ARMA members with clear options in relation to fire safety management that can be communicated to fire risk assessors and others.

Managing agents should inform the person completing the risk assessment:

- who the responsible person(s) is or are; and
- the limits of their responsibilities, as set out in their management agreement, for management in accordance with the Fire Safety Order.

Where managing agents have agreed to undertake duties in relation to fire safety management, instructing risk assessments, managing the risk assessment process or implementing any risk control actions identified in the risk assessment, it is essential that they undertake their duties effectively and in accordance with the requirements of the Fire Safety Order.

Where the scope of a managing agents management agreement only commits them to, for example, commissioning an FRA, it is essential that they make the client aware of the limitations of their agreement and any actions their client will need to do to discharge their duties under the Fire Safety Order.

Instructing more detailed assessments

A risk assessor should notify the responsible person, on whose authority they were instructed, where they believe, after having visited the premises and/or studied the available information, that the type of assessment instructed is not adequate to allow them to make a suitable and sufficient assessment of the risks.

The need for a more detailed assessment is usually required where the fire risk assessor, for example:

- was unable to identify the fire strategy for the building and therefore unable to determine whether all parts of the strategy (compartmentation, smoke extraction, etc.) were in place and effective;
- understood the fire strategy but without further investigation was unable to determine whether all parts of the strategy (compartmentation, smoke extraction, etc.) were in place and effective; and
- was unable to determine, without further investigation, whether components of the building, such as cladding or compartmentation, presented an unacceptable risk.

Reviewing a risk assessment

A risk assessment is usually a subjective process, and its findings will be based on the opinion and information available to the assessor at the time it is made. It is important that any actions and recommendations made in the assessment, or in relation to the type of FRA required, are fully understood by the responsible person and, where they have contractual responsibilities in relation to the assessment, the managing agent.

There is no reason why the views of a fire risk assessor should not be challenged, and issues should in all cases be discussed, where required, in order to ensure that you have a full understanding of what is required or being recommended.

Periodic review of FRAs

The responsible person must review the assessment regularly to keep it up to date, particularly if there is reason to suspect that it is no longer valid, or there has been a significant change to the structure, layout or use of the building, or the organisations involved in the management of fire safety or the fire safety arrangements change significantly. The frequency of review should be specified, by the risk assessor, as part of the FRA process.

Government guidance indicates that the frequency of review should take into account the rate with which changes, including those arising from the need for maintenance work, are likely to occur, and the risk to people that might arise from changes. This means that a less frequent review may be acceptable if there is close management control of the common parts, including frequent routine inspections.

On low-risk, modern, low-rise blocks (e.g. a block of no more than three storeys above ground, built within the last 20 years), a review every two years may be sufficient, with a new FRA completed every four years.

For blocks with higher risks – arising, for example, from social factors or the age of the building – and blocks over four storeys in height, an annual review might be more appropriate, with a new FRA every three years.

Reviewing frequencies of FRAs

Where they have agreed in their management agreement to manage fire safety or to commission FRAs on behalf of a responsible person, managing agents should, in consultation with the competent source of advice or their FRA company, review the buildings in their portfolio against the guidance given in the Home Office's Fire Safety in Purpose-built Blocks of Flats and Fire Safety Act Commencement Prioritisation Guidance to determine whether the current frequency is appropriate.

Before commissioning the review of an FRA to cover Section 1 of the Fire Safety Act 2022, the responsible persons, and anyone involved in the commissioning of the review, are advised to read the Home Office's Fire Safety Act Commencement Prioritisation Guidance.

Where significant risks, such as those associated with different types of cladding and non-compliant flat front doors, have been highlighted in government or FRS guidance and you know, or believe, that they may affect a particular property, you must take this into account when setting the date of the next review. The frequency of review may increase depending on changing risk factors, such as implementation of interim measures which must be factored into the FRA.

Collection of funds for FRAs or fire risk control actions

Where an FRA indicates that an action is required either to enable the assessor to undertake a compliant risk assessment, to implement a requirement of current fire safety legislation or to remove or reduce a risk, a lease will normally support the collection of funds to be able to take, the required action.

Fire risk action plans

As part of the FRA, a fire risk action plan should be produced that advises about the necessary changes to the fire safety arrangements for the block, should any be required. This should include the priority rating and timescales for completion of any recommended actions by the responsible person.

Those persons that are affected by the FRA should be made aware of its significant findings. In the simplest of blocks of flats, a standard fire safety notice may suffice, but otherwise a bespoke plan will be required that should be a working document.

Where managing agents manage a block where the fire risk assessor has recommended that reasonable and appropriate fire safety works are undertaken and the responsible person will not agree a timely plan to undertake the works, the managing agent should consider resigning, especially if failure to undertake the work will expose or prolong occupants' exposure to significant risk.

Even where a managing agent has not agreed to manage fire safety on behalf of their client, if the managing agent cannot demonstrate that they have taken all reasonable steps to ensure the requisite fire safety precautions are in place and a fire incident occurs, or if pre-emptive legal action is taken by the fire service prior to an incident occurring, the managing agent may be partly liable for any safety deficiencies along with the landlord, because they had, at the very least, a duty to advise their clients on their duties under fire safety legislation and the arrangement that would be expected to discharge those duties.

Resignation should of course be a last resort and then only once the managing agent has exhausted all avenues to persuade the client to take the appropriate action.

PART 3 – FIRE SAFETY MANAGEMENT

Fire strategies

There are three elements to a building's overall fire strategy, the:

- fire design strategy [the fire strategy];
- evacuation strategy; and
- fire risk management strategy.

The first two relate to a building. The last relates to the organisation or organisations that are managing the building.

This guidance focuses on the fire strategy and the evacuation strategy and how they work together. It is written in relation to English fire safety legislation but the principles it sets out are equally applicable in other jurisdictions.

The fire strategy should not change unless you reconfigure the building.

The evacuation strategy may need to change temporarily if:

- the built features of the fire strategy have degraded or altered to the point they will no longer support the evacuation strategy; or
- the building was not built in accordance with the fire strategy or to the appropriate standards and will not support the evacuation strategy.

The fire risk management strategy defines the organisation's fire risk management system and method of implementing its fire safety policy and in relation to a building will change each time the organisations managing a building change. A fire risk management strategy may be developed for an organization operating from a single premises, or for an organization with a multisite portfolio.

The Fire Strategy

For a building to be considered safe under the FSO and to allow fires to be fought, certain features need to be in place ("the required features").

In this document the fire strategy is these features and their integration.

There will be a fire strategy for every building; since 1965 the designer will have had a strategy for complying with the Building Regulations⁵, and this will have been approved by Building Control. Before that date it will have had to comply with local byelaws. Even if this was not written down and labelled a "fire strategy" or similar, the fire strategy for the building will be a fundamental part of the design. At its simplest, it is a strategy for complying with the Building Regulations or byelaws current as applied at that time.

Buildings, for many years, have been designed to meet fire safety standards (see Annex D – The History of Building Regulations). All new and altered or converted buildings must be designed and constructed in accordance with the relevant fire safety requirements which are, for projects that started after 1st October 2010, set out in Part B of Schedule 1 of the Building Regulations 2010.

Where blocks of flats were constructed before 1965, the need to comply with the requirements of the FSO, or other earlier fire safety legislation, may have resulted in significant changes to the original fire strategy. These changes can include additional compartmentation around means of escape and the installation of fire alarms.

Required features

The functional requirements are set out for:

- design and construction, in Part B of Schedule 1 of the Building Regulations 2010;
- occupation, in Article 4 of the FSO general fire precautions.

The required features will vary depending on:

- the evacuation strategy selected in the design;
- the design code selected by the designers (see Annex C – Fire Design Standards);
- the design choices made by the designers.

Legal standards

The legal standards in the table below set out the ‘functional requirements’ of the law. It compares the requirements of the current Building Regulations 2010 and the general fire precautions set out in the Fire Safety Order.

These high level ‘functional requirements’ are supplemented by the design code selected by the designers and used to establish the required features that, together, make up the fire strategy for the building.

Building Regulations – Schedule 1 Part B	FSO Article 4 – General fire precautions
	Measures to reduce the risk of fire on the premises.
<p>B2.—(1) To inhibit the spread of fire within the building, the internal linings shall:</p> <p>(a) adequately resist the spread of flame over their surfaces; and</p> <p>(b) have, if ignited, either a rate of heat release or a rate of fire growth, which is reasonable in the circumstances.</p> <p>B3.(1) The building shall be designed and constructed so that, in the event of fire, its stability will be maintained for a reasonable period.</p> <p>(2) A wall common to two or more buildings shall be designed and constructed so that it adequately resists the spread of fire between those buildings.</p> <p>(3) Where reasonably necessary to inhibit the spread of fire within the building, measures shall be taken, to an extent appropriate to the size and intended use of the building, comprising either or both of the following:</p> <p>(a) sub-division of the building with fire-resisting construction;</p> <p>(b) installation of suitable automatic fire suppression systems.</p> <p>(4) The building shall be designed and constructed so that the unseen spread of fire and smoke within concealed spaces in its structure and fabric is inhibited.</p> <p>B4. (1) The external walls of the building shall adequately resist the spread of fire over the walls and from one building to another, having regard to the height, use and position of the building</p>	Measures to reduce the risk of the spread of fire on the premises.

Building Regulations – Schedule 1 Part B	FSO Article 4 – General fire precautions
B1. The building shall be designed and constructed so that there are ... appropriate means of escape in case of fire from the building to a place of safety outside the building capable of being safely and effectively used at all material times.	Measures in relation to the means of escape from the premises.
	Measures for securing that, at all material times, the means of escape can be safely and effectively used.
B5. (1) The building shall be designed and constructed so as to provide reasonable facilities to assist fire fighters in the protection of life. (2) Reasonable provision shall be made within the site of the building to enable fire appliances to gain access to the building.	Measures in relation to the means for fighting fires on the premises.
B1. The building shall be designed and constructed so that there are appropriate provisions for the early warning of fire.	Measures in relation to the means for detecting fire on the premises and giving warning in case of fire on the premises.

Required Features

The required features include, where relevant:

- an external envelope that prevents the spread of fire from one level or compartment to the next, and from the building to another;
- a structure that is protected from or resistant to fire to the extent necessary to prevent a collapse;
- internal compartmentation to support a stay put policy, to protect the means of escape, to provide firefighting lobbies, etc.;
- fire doors, fire curtains, etc.
- a fire and smoke detection system to trigger an alarm or other fire safety devices;
- a standalone alarm system or one triggered by automatic detection;
- wet or dry firefighting mains;
- fire suppression systems including sprinklers and water mist systems;
- smoke control systems;
- emergency lighting and generators;
- firefighting and fire evacuation lifts; and
- fire appliance access routes.

Standards in occupation

The Grenfell inquiry has however proved that there is no guarantee that the approved fire strategy was compliant or that the construction was to the approved design.

The requirements of the FSO comes into force once the building work is complete. The Building Regulations define what is suitable. The FSO requires compliance even where the building has not been designed or built to conform to the Building Regulations.

Where the fire strategy developed by the designers was not compliant, or the required features were not put in place to the appropriate standards, as part of the design and construction process, Article 8 of the FSO (which is the duty to take general fire precautions), requires the responsible person to:

- take such general fire precautions as will ensure, so far as is reasonably practicable, the safety of any of his employees; and

- in relation to relevant persons who are not his employees, take such general fire precautions as may reasonably be required in the circumstances of the case to ensure that the premises are safe.

In this context, relevant persons are any person who is or may be lawfully on the premises; and any person in the immediate vicinity of the premises who is at risk from a fire on the premises, such as residents, contractors, etc.

In taking action to ensure that a building meets with the requirements of Article 8 of the FSO, the current Building Regulations, and a relevant standard, will need to be used to specify any remedial work. The work itself will be subject to the building control approval process. Compliance with Article 8 of the FSO and compliance with the Building Regulations are therefore inextricably linked.

The need for understanding the fire strategy

During the occupation of a building:

- FSO Article 8, Duty to take general fire precautions, requires:
 - o such general fire precautions to be taken as will ensure, so far as is reasonably practicable, the safety of any of his employees; and
 - o in relation to relevant persons, such general fire precautions to be taken as may reasonably be required in the circumstances of the case to ensure that the premises are safe.
- FSO Article 17, Maintenance, requires that any facilities, equipment and devices provided in respect of the premises under the FSO are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair.

To be able to do this you need to:

- identify what required features are, or need to be, in place to ensure that the building is considered safe under the FSO and to allow fires to be fought;
- validate and evidence that the required features are in place;
- implement, in accordance with Article 17, a suitable system of maintenance to ensure that the features are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair.

Reviewing, updating or compiling a fire strategy

A fire strategy should explain the nature, function and capabilities of the fire precautions that have been designed and constructed into the building and provide details of:

- the legislative basis for the design and the standards that have been used;
- all assumptions in the design of the fire safety features such as:
 - o fire load;
 - o any risk assessments, risk analysis or risk profile;
 - o escape distances;
 - o the type of use; and
 - o the volume of persons using any floor, escape route or emergency exit;
- all assumptions in the design of the fire safety arrangements regarding the fire safety management of the building, including emergency procedures;
- the evacuation strategy, escape routes, final exits and fire assembly points;
- all passive fire safety measures, e.g. compartmentation, fire stopping, cavity barriers, fire doors, duct dampers and fire shutters and signage;
- the fire resistance of and fire protection to the structure;
- any fire and smoke detection systems and how they interact with other systems such as smoke control and ventilation systems;
- any emergency lighting or emergency power supply installed;
- the fire-fighting measures including hydrants, any dry or wet risers and first aid and other firefighting equipment;
- exterior facilities for fire and rescue services;
- details of all active fire safety measures, such as sprinkler systems and smoke control systems;
- information about any elements of the fabric and services that may adversely affect the general fire precautions in a fire, such as internal wall and ceiling linings, roof

- coverings, rooflights and other thermoplastic materials and external wall cladding;
- information on the requirements of the fire safety equipment including operational details, manuals, software, routine testing, and inspection and maintenance schedules; and
- provisions incorporated into the building to facilitate the evacuation of people with disabilities and other potentially vulnerable people.

Whilst strategies must be proportionate to the risk, they must always contain sufficient information to:

- allow the responsible person to demonstrate that the general fire precautions:
 - o will ensure, so far as is reasonably practicable, the safety of their employees (if they have any); and
 - o are sufficient to make the premises are safe for relevant persons
- implement a suitable system of maintenance to ensure that the facilities, equipment and devices provided in respect of the premises under the FSO are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair.

Should a fire strategy be written down

New, altered and extended buildings: Since 1st October 2010 Regulation 38 of the Building Regulations (which covers fire safety information) has required that when a building being constructed, altered, or extended will fall within the scope of the FSO, the person carrying out the work gives fire safety information to the responsible person.

Fire safety information in this context is information relating to the design and construction of the building or extension, together with the services, fittings and equipment provided in or in connection with the building or extension which will assist the responsible person to operate and maintain the building or extension with reasonable safety.

The aim of the fire safety information is to ensure that the responsible person has sufficient information relating to fire safety to enable them to manage the building effectively and, in particular, enable them to:

- understand and implement the fire safety strategy of the building;
- maintain any fire safety system provided in the building; and
- carry out an effective fire risk assessment of the building.

Approved Document B¹³, Volume 1, 2019 edition³, Section 17 Fire safety information sets out in detail what is expected.

Existing buildings: A responsible person cannot manage a building if they do not understand the fire strategy for the building because:

- they cannot demonstrate that the general fire precautions:
 - o will ensure, so far as is reasonably practicable, the safety of their employees (if they have any); and
 - o are sufficient to make the premises are safe for relevant persons
- they will find it hard to implement a suitable system of maintenance to ensure that the facilities, equipment and devices provided in respect of the premises under the FSO are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair.

Documenting a fire strategy provides assurance, evidence and resilience.

Article 6 of the FSO article requires the responsible person where:

- they employ five or more employees;
 - a licence under an enactment is in force in relation to the premises; or
 - an alterations notice requiring this is in force in relation to the premises;
- to, as soon as practicable after a fire risk assessment is made or reviewed, record the following prescribed information:
- the significant findings of the assessment, including the measures which have been

-
- or will be taken by the responsible person pursuant to this Order; and
- any group of persons identified by the assessment as being especially at risk.

The measures which must be taken by the responsible person to comply with the FSO include the general fire precautions. The general fire precautions include the features set out in the fire strategy. Where the conditions set out in Article 6 apply, the responsible person must record and, where necessary, update the fire strategy.

A fire risk assessor cannot undertake a suitable fire risk assessment if they do not understand the engineered fire strategy for the building. A fire risk assessor cannot assess risks when they do not understand the strategy those risks are being assessed against.

Therefore, even where the conditions set out in Article 6 do not apply, it would be best practice, in all cases, to keep a record of the fire strategy, because it provides evidence of compliance with the general fire precautions and without evidence of the fire strategy it will be impossible for a fire risk assessor to review the fire risk assessment.

It is important to record what you know, or have discovered, even if you do not, yet, fully understand the entire fire strategy.

When looking for the original engineered fire strategy, the local authority building control department, where they were the building control authority for the building, may have access to documents that formed part of the building control submission.

You will need to consider the terms of the leases for the building to be satisfied that the costs are recoverable via the service charge mechanism. Additionally, you will also need to consider section 19 of the Landlord and Tenant Act 1985 which protects leaseholders from paying for costs which have not been reasonably incurred. If in doubt as to the recoverability of costs associated with identifying and recording the fire strategy, then you should take professional advice.

Evacuation strategies

Although emergency evacuation is the immediate and urgent movement of people away from the threat or actual occurrence of a fire, not all evacuation strategies require all people in the building to immediately evacuate from the building. The primary objective of an evacuation strategy is to make sure, in the event of a fire, the occupants of a building are safe and can, if necessary, reach a place of ultimate safety outside the building. Evacuation procedures are an essential part of the overall fire strategy.

All buildings are designed to support a particular type of fire strategy or fire strategies. The default strategy in purpose built blocks of flats will be a stay put policy.

The stay put philosophy

The stay put philosophy has underpinned fire safety design of flats since before the 1960s, when national standards were first drafted. This principle is still used to design blocks of flats today; in the majority of existing blocks, it remains entirely valid.

The stay put philosophy is based on the design principle that only the residents of the flat of fire origin need to escape initially, while other residents may remain in their own flats unless their flat is affected by fire or smoke, they feel threatened, or they are instructed to leave by the fire and rescue service [FRS]. A stay put strategy does not preclude residents, who are aware of a fire within the building but not affected directly by it, from deciding to evacuate.

In a building designed to support a stay put policy there is usually no need for a common fire alarm except where there are communal spaces such as lounges and laundries in the common parts where an alarm is required within these areas, this alarm will be separate from any other devices that may be fitted within apartments. Alarm systems consisting of mains powered fire alarms or single point detectors are also

required within flats.

Blocks of flats designed to support the stay put principal are subject to the following common design principles:

- each flat is formed within its own fire-resisting enclosure with a high degree (60 minutes) of compartmentation between each flat, and between flats and the common parts of the block;
- there is a low probability of fire and smoke spread beyond the flat of a fire's origin; and
- there is a low fire risk in common areas due to precautionary management.

Providing the stay put design principles are in place and the fire risk assessment has confirmed that all other necessary fire precautions are in place to support the stay put policy, then the following fire safety measures may be appropriate:

- residents in the flat that is originally affected by the fire should evacuate and immediately call the fire service – other residents are safe to stay in their flats without the need for immediate evacuation;
- there is usually* no requirement for fire alarms in common areas;
- there is no requirement for fire extinguishers in common parts except for plant and service rooms; and
- emergency lighting, in accordance with BS 5266 Emergency lighting. Code of practice for the emergency lighting of premises, is required in common parts, stairs and corridors, and plant and service rooms.

* There are a number of circumstances when fire detectors and alarms are required in common areas. The circumstances are explained in detail later in this guidance in the section covering Fire Detection and Alarm Systems.

Simultaneous evacuation

Simultaneous evacuation is a procedure in which all parts of a building are evacuated in the event of fire at one time. A building designed to support simultaneous evacuation requires a common fire and smoke alarm system, designed in accordance with the recommendations of BS 5839-1:2017, to be installed. The sound level of such a system must be capable of being heard in all areas of the building, with a sound pressure level of 75dB at each bedhead.

Phased evacuation

Phased evacuation is a strategy in which the people immediately affected by the fire are evacuated first, followed in phases by those likely to be affected next. Where phased evacuation is employed it is common for the means of escape not to have sufficient capacity for the total population to evacuate simultaneously, such as in a building height greater than 30m.

The design of buildings incorporating phased evacuation is such that many safety facilities have been provided so as to enable people to remain in the building for longer periods than would normally be encountered.

The fire alarm system will be designed to give two distinctly different signals (warning and evacuation) or give appropriate voice messages.

Phased evacuation will normally be managed by a competent person on behalf of the Responsible Person in conjunction, upon the arrival of the fire and rescue services, with the Incident Commander, although the initial phase of the evacuation will occur automatically on the sounding of the fire alarm.

Progressive evacuation

Progressive evacuation is the process of evacuating people, through fire-resisting construction, into an adjoining fire compartment or refuge area, free from the effects of fire or smoke, from where they can later evacuate further if required. Progressive evacuation is commonly employed where it is desirable or necessary for the building occupants not to leave the building entirely such as hospital patients, where the occupants may need assistance to evacuate further, such as mobility-impaired people who may not be able to use stairs, or where a significant operational loss would be incurred by the total and immediate evacuation of a large building, such as a large shopping centre, for a small fire.

The fire alarm system will be designed to give two distinctly different signals (warning and evacuation) or give appropriate voice messages.

Progressive evacuation will normally be managed by a competent person on behalf of the Responsible Person in conjunction, upon the arrival of the fire and rescue services, with the Incident Commander, although the initial phase of the evacuation will occur automatically on the sounding of the fire alarm.

Two-staged alarm evacuation

In a two-staged alarm evacuation strategy staff are alerted to a potential fire before the general population, so that they may investigate the fire or prepare for a stewarded evacuation and, if necessary, cancel the alarm or escalate to the evacuation stage. Usually, the main alarm will sound if staff confirm the presence of fire by activation of manual call points (MCP), if additional detectors are activated or after a predetermined time elapses without the alarm being cancelled. Two-staged alarm evacuation is commonly employed where there is a high-density awake and unfamiliar population, and a stewarded evacuation is desirable to avoid panic and disorder. Two-staged alarm evacuation strategies can minimise Unwanted Fire Signals (fire alarm false alarms) that result in the Fire and Rescue services being called out unnecessarily.

Variations

The strategies detailed above are not mutually exclusive and may be used in combination for example: progressive evacuation to refuge areas followed by phased evacuation of the refuge areas to a place of ultimate safety.

Fire Risk Management Strategy

Current fire safety legislation includes both:

- general duties to:
 - o take such general fire precautions as will ensure, so far as is reasonably practicable, the safety of any employees; and
 - o in relation to relevant persons who are not employees, take such general fire precautions as may reasonably be required in the circumstances of the case to ensure that the premises are safe, and
- specific duties in relation to the effective planning, organisation, control, monitoring and review of the measures required to ensure compliance with the legislation.

The specific duties include requirements to assess risk, have suitable arrangements (and write them if they are employers that have five or more employees), appoint competent persons to assist with the required measures, inspect and maintain the fire safety features and train employees.

The fire risk management strategy defines the organisation's fire risk management system and method of implementing its fire safety policy and needs to address:

- fire risk assessment;
- resources and authority;
- fire safety training;
- control of work on site;

- maintenance and testing;
- communication; and
- emergency planning.

The fire risk management strategy is a key element of planning in the plan, do, check, act model.

Fire safety information

The Fire Safety (England) Regulations 2022

The Fire Safety (England) Regulations 2022 will, when they come into force on 23rd January 2023, impose a number of duties on responsible persons in relation to the preparation and maintenance of records.

In high-rise residential buildings, responsible persons will be required to:

- prepare, and revise if there are any significant changes to the external walls, a record of the design of the external walls of the building, including details of the materials from which they are constructed; the record must include details of the level of risk identified in the FRA that the design and materials of the external walls give rise to and any mitigating steps that have been taken in respect of that risk;
- prepare a plan for each floor of the high-rise residential building*, that together, identify the location of all lifts and identify if the lift is one for use by firefighters or an evacuation lift, and the key fire-fighting equipment in the whole building;
- prepare a single-page building plan identifying:
 - o the environs of the building;
 - o details of the use of the building, for example for commercial or residential purposes;
 - o access for fire and rescue appliances;
 - o the dimensions of the building;
 - o information on the number of storeys of the building and the number of basement levels(if any);
 - o information regarding the presence of maisonettes or scissor-section flats;
 - o inlets for dry-rising mains;
 - o inlets for wet-rising mains;
 - o the location of shut-off controls for any sprinklers;
 - o access points for the building;
 - o the location of the secure information box;
 - o the location of the controls for any smoke control system;
 - o the location of any firefighting shaft;
 - o the location of main stairways in the building;
 - o the location of the controls for any evacuation alert system.
- update the floor plans and building plan as soon as reasonably practicable after any change to the layout of the building or location of key fire-fighting equipment; and
- provide the local FRS by electronic means with the documents set out above.

* A plan will need to be prepared for each floor, but where floors are identical only one plan needs to be produced.

The government plans to publish guidance to support the requirement to record of the design of the external walls of the building. This will include a suggested template to assist the responsible person in sharing the right information with the FRS.

Plans should be a reasonably accurate reflection of each floor of the building and must clearly indicate to firefighters which floor(s) it relates to and show the location of the firefighting equipment set out in the regulations.

Examples of plans are included in the Code of Practice for the Provision of Premises Information Boxes in Residential Buildings²¹ (pp. 22-29).

The Building Regulations

The Building Regulations require that the 'person carrying out the work' to provide the responsible person with fire safety information no later than the date of completion of the work, or the date of occupation of the building or extension, whichever is the earlier. The duty applies where building work:

- consists of or includes the erection or extension of a relevant building; or
- is carried out in connection with a relevant change of use of a building,

A relevant building is a building to which the Fire Safety Order applies, or will apply after the completion of building work, and includes the following parts of a building that contains two or more sets of domestic premises:

- the building's structure;
- external walls including any doors or windows in those walls and anything attached to the exterior of the walls (including balconies); and
- any common parts including all doors between the domestic premises and common parts.

Fire safety information is defined in the Building Regulations as '*information relating to the design and construction of the building or extension, and the services, fittings and equipment provided in or in connection with the building or extension which will assist the responsible person to operate and maintain the building or extension with reasonable safety.*'

The aim of the fire safety information is to ensure that the responsible person has sufficient information relating to fire safety to enable them to manage the building effectively and, in particular, enable them to:

- understand and implement the fire safety strategy of the building;
- maintain any fire safety system provided in the building; and
- carry out an effective FRA of the building.

Approved Document B, Volume 1, 2019 edition, Section 17 Fire safety information sets out in detail what is expected.

Construction (Design and Management) Regulations

Regulation 4(5) of the Construction (Design and Management) Regulations [CDM regulations] requires the client to ensure that the principal designer prepares a health and safety file for the project.

The health and safety file must contain information relating to the project that is likely to be needed during any subsequent project to ensure the health and safety of any person.

At the end of any project to which the CDM regulations apply, the principal designer, or where there is no principal designer the principal contractor, must pass the health and safety file to the client.

L153, the HSE's guidance to the CDM regulations, states the following:

The file must contain information about the current project likely to be needed to ensure health and safety during any subsequent work, such as maintenance, cleaning, refurbishment or demolition. When preparing the health and safety file, information on the following should be considered for inclusion:

- a brief description of the work carried out;
- any hazards that have not been eliminated through the design and construction processes, and how they have been addressed (eg surveys or other information concerning asbestos or contaminated land);
- structural principles (e.g. bracing, sources of substantial stored energy – including pre- or post-tensioned members) and safe working loads for floors and roofs;
- hazardous materials used (eg lead paints and special coatings); information

regarding the removal or dismantling of installed plant and equipment (eg any special arrangements for lifting such equipment);

- *health and safety information about equipment provided for cleaning or maintaining the structure; the nature, location and markings of significant services, including underground cables; gas supply equipment;*
- *firefighting services etc; information and as-built drawings of the building, its plant and equipment (eg the means of safe access to and from service voids and fire doors).*

If a client disposes of their interest in a property, they must hand over the health and safety file for the property to the person who acquires the property, and ensuring that they are aware of the nature and purpose of the file.

Reviewing information

Prior to taking control of a new property or prior to completion of any work on the property to which either the Building Regulations or the CDM regulations apply, the responsible person should ensure that the information provided is sufficient and satisfactory to enable them to manage the building in accordance with all current fire safety legislation.

Fire safety arrangements

Legal requirements

Article 11 of the Fire Safety Order requires the responsible person to draw up and implement appropriate arrangements as appropriate for the effective planning, organisation, control, monitoring and review of the preventive and protective measures which have been identified by the risk assessment as the general fire precautions they need to take to comply with the requirements and prohibitions imposed on him/her by or under the Order.

The arrangements will range from something very simple to a safety management system.

These arrangements will typically also relate to measures required by other articles in the Fire Safety Order, such as those for the appointment of competent persons to assist the responsible person, maintaining the premises and any facilities, equipment, and devices (organisation and control) and the need to review the risk assessment (monitoring).

The purpose is to ensure effective management control of the fire safety arrangements in the premises.

The arrangements must be appropriate for the complexity of the fire safety systems in the property and the hazards and risks that are present.

Although arrangements must only be recorded where five or more persons are employed, it would be good practice to always record the arrangements to allow the responsible person to evidence that they have suitable arrangements.

Arrangements should:

- detail responsibilities for both compliance with the Fire Safety Order and implementing the arrangements;
- set out the standards of competence and training required by those with duties and responsibilities under the Fire Safety Order for the effective planning, organisation, control, monitoring and review of the preventive and protective measures;
- detail the maintenance, test and inspection requirements for preventive measures

-
- including:
- o arson prevention;
 - o gas safety;
 - o electrical safety;
 - o build-up of rubbish;
 - o lightning protection;
 - o compartmentation;
 - o fire-resisting door sets in the common parts and at the entrances of individual domestic premises;
 - o fire stopping; and
 - o cavity barriers
- detail the maintenance, test and inspection requirements for protective measures including:
 - o means of escape;
 - o fire detection and fire alarm systems;
 - o evacuation alert systems;
 - o automatic fire suppression (sprinklers, misting systems, etc.);
 - o lifts for use by firefighters;
 - o dry-rising mains and their inlets and outlets;
 - o wet-rising mains and their inlets and outlets;
 - o smoke control systems;
 - o gas cut-offs/utility isolation points
 - o fire protection to service shafts and risers;
 - o emergency lighting
 - o automatic door release mechanisms linked to fire alarm systems;
 - o refuge call systems; and
 - o evacuation lifts;
 - include planned and preventative maintenance and inspection programmes;
 - include the arrangements with leaseholders made under Article 17(2) of the Fire Safety Order to ensure that preventive or protective measure that is demised to the leaseholder, or can only be accessed by entering areas demised to the leaseholder, are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair;
 - include evacuation plans which include arrangements for those who have self-identified as being unable to self-evacuate;
 - include resident engagement programmes including communication on preventive and protective measures that residents should implement and evacuation plans;
 - include contractor competence assessment systems and programmes;
 - detail the hot work procedures; and
 - include details for the management, monitoring and review of:
 - o preventive and protective measures which have been identified by the risk assessment as the general fire precautions that need to be taken to comply with the requirements and prohibitions imposed on him/her by or under the Order;
 - o fire safety information provided in accordance with the requirements of Regulation 38 of the Building Regulations;
 - o fire safety maintenance, test and inspection records (although there is no expressed requirement to record the results of routine inspection, it would be good practice to keep records that allow the responsible person to evidence that testing has taken place);
 - o dutyholder competence and training records;
 - o contractor competence records;
 - o hot work management records; and
 - o the fire safety arrangements.

Although it is not a requirement of the Fire Safety Order, it is best practice to have documented arrangements for:

- engaging competent fire risk assessors;
- commissioning FRAs; and
- monitoring and reviewing fire risk assessors and FRA standards.

Ownership

The duty to have suitable arrangement sits with the responsible person.

Where a managing agent has agreed in the management agreement to manage fire safety and/or any of the preventive and protective measures, they must obtain a copy of the responsible person's fire safety arrangements and ensure that any action they take is undertaken in accordance with the arrangements.

Where the responsible person has no arrangements, the managing agent should make them aware of the requirements to have arrangements in place and ensure that these suitable arrangements are prepared by the responsible person, or where their management agreement requires, by them, on behalf of, the responsible person.

Where a managing agents has agreed in the management agreement to provide advice on fire safety management or the requirements of fire safety legislation they must ensure that the responsible person is given suitable advice on their duties to have suitable fire safety arrangements and the required contents of the arrangements.

The fire safety arrangements and any records belong to the responsible person. Where a managing agent manages fire safety for, or on behalf of, a responsible person, they must ensure that any records are passed to the responsible person upon completion of their contract.

Safety management systems

A safety management system is a formal management system or overall framework that can help manage fire safety risks. Higher-risk buildings that fall within the scope of the Building Safety Act will be required to have a safety management system to manage building safety risks.

The Health and Safety Executive's (HSE) model for safety management systems is based on the Plan, Do, Check, Act approach:


Plan	Determine your policy/Plan for implementation
Do	Profile risks/Implement your plan
Check	Measure performance
Act	Review performance/Act on lessons learned

Documents produced as part of any system should be functional and concise to be effective.

Good fire safety arrangements should always follow the Plan, Do, Check, Act approach. Further information on the approach can be found in Managing for Health and Safety (HSG65).

If you are looking to implement a fire safety management system to a recognised standard, you should consider BS 9997:2019 Fire risk management systems – Requirements with guidance for use⁵⁷.

The diagram below shows a typical management system. The numbers are the clause numbers in BS 9997:2019.

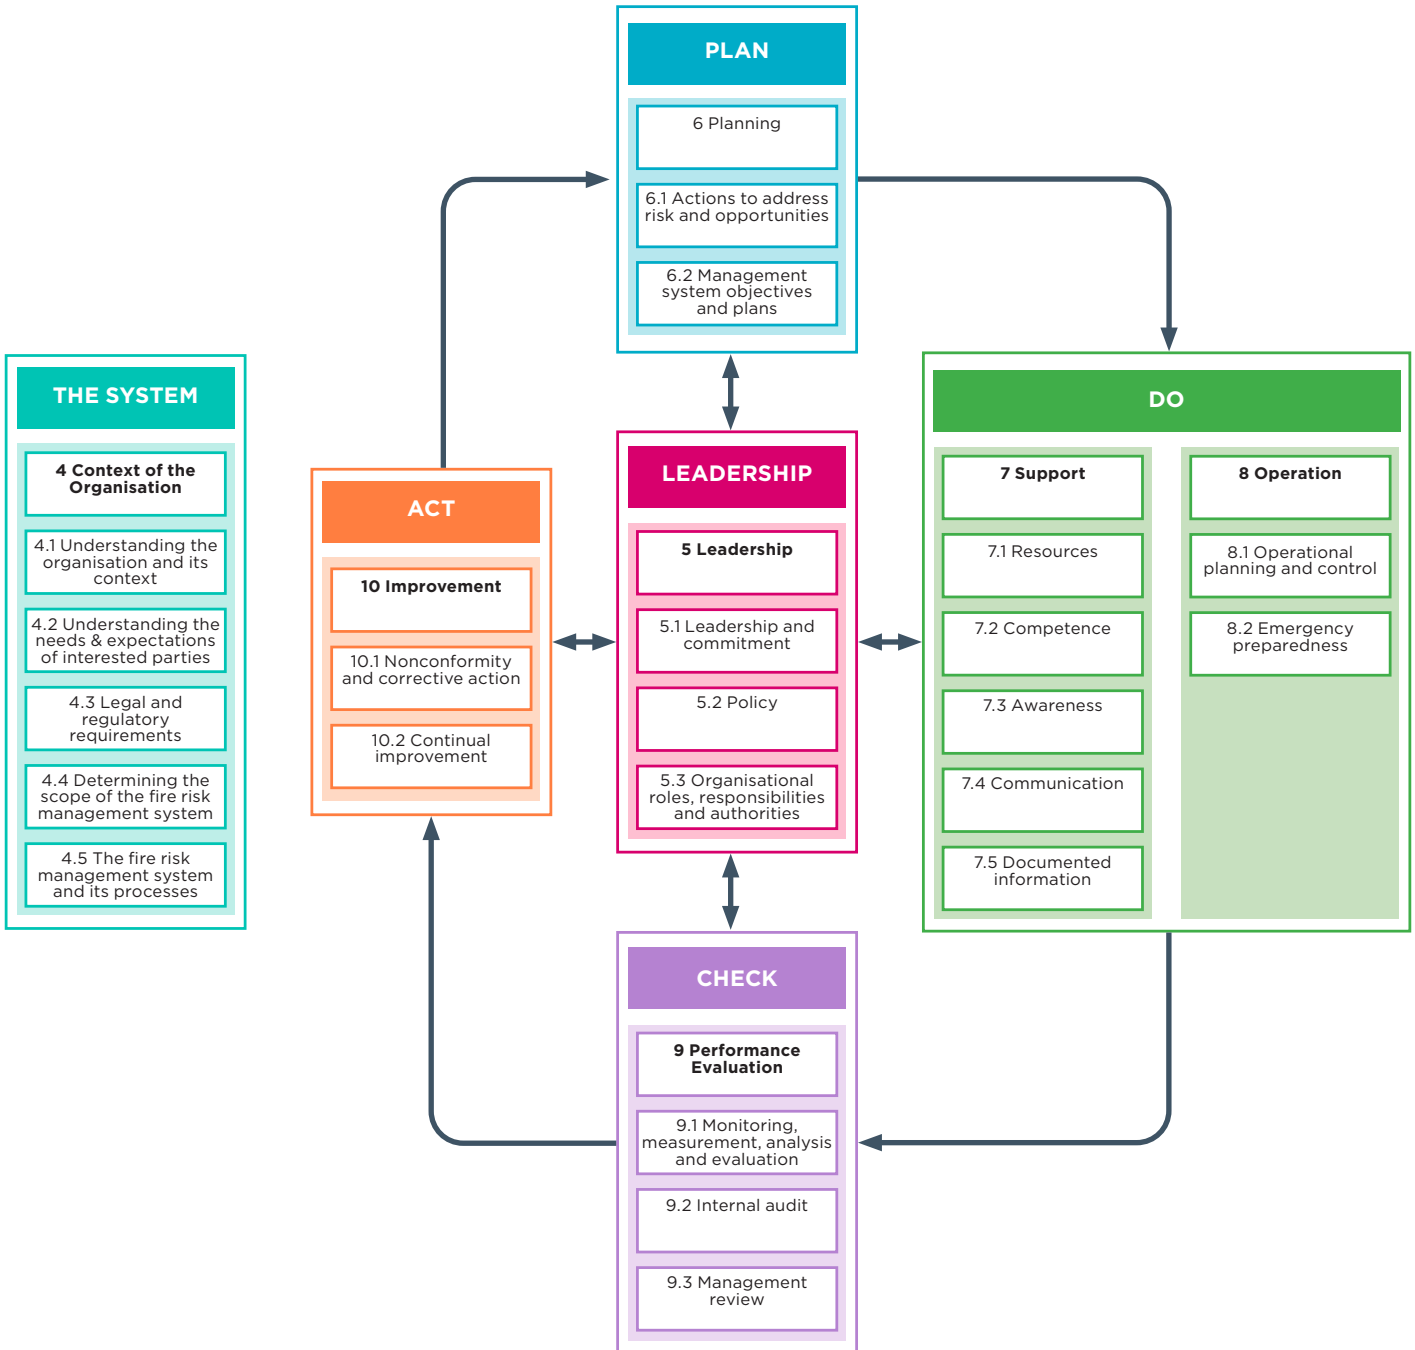

PART 4 – MANAGING FIRE RISKS

Emergency routes and exits

In order to safeguard the safety of relevant persons, the responsible person must ensure that routes to emergency exits from premises and the exits themselves are kept clear at all times.

It must be possible for persons to evacuate the premises as quickly and as safely as possible.

The number, distribution and dimensions of emergency routes and exits provided during the design and construction are to be suitable for the occupation type of the building, the size of the premises and the maximum number of persons who may be present.

Emergency doors must not be locked or fastened in a way that means they cannot be easily and immediately operated using a single action by any person.

Emergency routes and exits must be indicated by signs.

Emergency routes and exits requiring illumination must be provided with emergency lighting of adequate intensity in the case of failure of normal lighting.

Fire detection and alarm systems

Detection and alarms in common parts

In 'general needs' blocks designed to support a Stay Put policy, it is unnecessary and undesirable for a common areas fire alarm system to be provided. A common areas fire detection and alarm system will inevitably lead to a proliferation of false alarms. This will impose a burden on FRSs and lead to residents ignoring warnings of genuine fires.

Although a fire may occur in the common parts of the building, the materials and construction used should prevent the spread beyond the immediate vicinity. However, it is essential that common parts remain free from combustible materials and ignition sources at all times.

There are some cases where communal spaces, such as residents' lounges, recreation rooms and laundries, exist and where additional measures, such as a communal fire alarm system, are required.

Depending on the engineering of the building, smoke detection may also be provided in order to operate automatically opening vents and smoke clearance ventilation to clear smoke from common areas.

Fire alarms may be installed to support a temporary change to a Simultaneous Evacuation strategy in response to the risk of rapid fire spread from combustible external wall systems and/or other serious building defects.

Evacuation Alert Systems (EAS), to be used by the FRS in the event of emergencies in apartment blocks, may be installed in buildings with a Stay Put evacuation strategy. When required, EAS should be installed in accordance with BS 8629 – Code of practice for the design, installation, commissioning and maintenance of evacuation alert systems for use by FRSs in buildings containing flats⁵¹. You should consult with the local FRS before installing an EAS.

It is important, where a fire alarm or detection system is installed, that you seek advice from a competent person to verify its purpose and, where necessary, compatibility with the building's evacuation strategy.

Unwanted fire signals

Over many years, the FRS have been working with partners to reduce the number of unwanted fire signals (UwFS) that are generated from premises protected by automatic fire detection and fire alarm (AFA) systems.

UwFS erode users' confidence in the value and reliability of AFA systems and discourage people from taking these systems seriously and acting appropriately when they hear an alarm.

When UwFS trigger calls to the FRS, it diverts essential services from emergencies, putting life and property at risk.

The NFCC have published Guidance for the Reduction of False Alarms & Unwanted Fire Signals²⁰. The guidance calls for responsible persons to:

- ensure that AFA's are designed, installed, commissioned, managed and maintained in accordance with British Standards, to minimise the potential for false alarms;
- establish a level of cooperation with installers, maintainers and, where appointed, monitoring companies, to support the minimisation of false alarms;
- have effective procedures in place so that fire alarm evacuation is managed appropriately to minimise UwFS and ensure, so far as is reasonably practicable, that a call being passed to the FRS is a fire event; and
- consider the appointment of third-party certificating professionals as necessary to support comprehensive management of AFA systems.

Detection and alarms in flats

Flats constructed in accordance with the requirements of the 2006 edition of Approved Document B Volume 2¹⁴ (hereafter the ADB) will have been fitted with a system incorporating one or more interlinked mains-powered smoke and heat alarms. Each alarm will have its own integral standby supply and will be interlinked by wire or radio. Smoke alarms will normally be positioned in the circulation spaces between sleeping spaces and places where fires are most likely to start, such as kitchens and living rooms, to pick up smoke in the early stages.

Where the kitchen area is not separated from the circulation space by a door, there should be a compatible heat detector or heat alarm in the kitchen in addition to whatever smoke alarms are needed in the circulation space.

Smoke detectors should not be fixed in bathrooms, showers or cooking areas where steam, condensation or fumes could give rise to false alarms.

Leaseholders should ensure that the system is maintained and when required detector heads replaced in accordance with the manufacturer's instructions.

In flats constructed before the requirements of the 2006 ADB, leaseholders should be encouraged to install smoke and heat detectors within their flats to ensure that relevant persons can evacuate safely. Detectors and detection systems should:

- wherever possible be mains-powered and designed to the standards expected by the ADB; and
- be tested at least monthly.

Compartmentation and flat front doors

Compartmentation

Purpose-built blocks of flats are usually subject to the following common design principles:

- there is a high degree of compartmentation between each flat, and between flats and the common parts of the block;
- each flat is formed within its own fire-resisting enclosure;
- there is a low probability of fire and smoke spread beyond the flat of a fire's origin;

and

- there is a low fire risk in common areas due to precautionary management.

Compartmentation around flats should ensure that a fire is contained within the flat of origin until extinguished by the fire service.

Front doors of flats

Whether the front doors of flats are demised to the leaseholder or the landlord, they are an essential part of the fire and smoke containment plan of a block of flats.

All fire doors in any multi-occupied residential building, including individual flat entrance doors, play an essential part in ensuring that the whole of the building is safe as they form a key element of the building's compartmentation and mitigate the risk of the spread of fire throughout the building. It is clear that any suitable and sufficient FRA will need to include a consideration of all the fire doors in the premises – including flat entrance doors – to properly mitigate any risk to relevant persons from the spread of fire.

Fire doors have at least one of two functions:

- to protect escape routes from the effects of fire so that occupants can reach a final exit; and/or
- to protect occupants, firefighters and the contents and/or structure of a building by limiting the spread of fire.

The FRA can also be used to determine whether it is the doorset (the door, door frame, ironmongery, fixings and fire stopping) or door leaf (the door) that needs to be changed. Such assessments should be undertaken by a competent person who has completed appropriate training and is registered on a relevant UKAS-accredited scheme such as Bluesky Certification³⁵.

The current version of ADB requires the doorset that separates a flat from a space in common use to be at least FD30S, meaning it gives fire resistance of not less than 30 minutes (FD30) and the same resistance to the passage of smoke at ambient temperature conditions (S).

In the case of a property with a fire-engineered design solution, the fire doorset may be required to provide higher levels of fire and smoke resistance.

A fire doorset should be provided with self-closing devices that are manufactured and installed in accordance with BS EN 1154:1997³⁷ and fire-rated hinges in accordance with BS EN 1935:2002³⁸.

Where flat front doors are demised to leaseholders

Most leases will include a clause requiring leaseholders to comply with statutory requirements in respect of their own premises and/or to maintain their property in a condition to prevent others being put at risk. This includes maintaining any fire doors in a suitable condition.

Managing agents should use the lease, where they can, to ensure that front doors of flats that are demised to the leaseholder are maintained in a suitable condition.

Not all leases are the same, so a managing agent should consult the building's leases before acting.

Article 17 of the Fire Safety Order 2005 requires, where it is necessary in order to safeguard the safety of relevant persons, that the responsible person ensures that the premises and any facilities, equipment and devices provided in respect of the premises under this Order, or under any other enactment, are subject to a suitable system of maintenance and are kept in an efficient state, in working order and in good repair.

Flat front doors will generally have been installed to comply with the requirements of the Building Regulations in place at the time of construction. Since 1965, their purpose

has been as part of the compartment wall required to separate the flat from other parts of the building. The doors are required to protect the common parts of the building from a fire in a flat and certainly since 1965 have been installed in accordance with the requirements of the relevant Building Regulations, all of which would be considered one of the 'any other enactments' referenced above. [Article 17\(4\)](#) also states that where the premises form part of a building, the responsible person may make arrangements with the occupier of any other premises forming part of the building for the purpose of ensuring that the requirements are met and 'the occupier of the other premises must co-operate with the responsible person'. This duty 'applies even if the other premises are not premises to which this Order applies'. This therefore includes the leaseholders of flats which fall outside the scope of the Fire Safety Order.

This view is supported by the Chief Fire Officers Association's (now the NFCC) Collected perceived insights into and application of the Regulatory Reform (Fire Safety) Order 2005 for the benefit of enforcing authorities – 2015 [Enforcers' Guidance]²⁴:

'It must be noted that the occupier is required to co-operate by virtue of article 17(4) therefore it is possible to enforce on a occupier of a domestic premises where that person's premises may impact upon the fire safety of the remainder of the premises. However, the extent to which that occupier may be considered to be a person on whom duties are imposed by virtue of article 5(3) will depend on the circumstances of the case. The article was intended to provide landlords with some backing that they could cite in the civil courts. Where the responsible person breaches article 17 because the occupier of parts of the premises to which the Order does not apply will not co-operate (for example over maintenance of a fire alarm system that extends into a private flat) then that occupier could be prosecuted by virtue of article 32(10) or may be held as a duty holder under article 5(4).'

Should a leaseholder wish to change or alter their front door, then managing agents must ensure that they do so only after obtaining Building Regulations approval. This is to prevent the spread of fire outside the flat of origin for the relevant period of time and to protect the means of escape from the building, allowing safe access for the FRS to fight the fire and to allow escape from the building should the need arise.

Most leases will require leaseholders to apply for a licence to alter before they make changes to their property. The requirement usually includes any alterations to the fire door to a property.

Managing agents should take appropriate action where a licence has not been obtained.

Where a front door is replaced or altered and the work does not comply with the relevant requirements of the Building Regulations, a managing agent should, when taking action, first look to the lease. Where there is no appropriate provision in the lease, and the leaseholder refuses to take appropriate action, the local authority has a duty to enforce when they become aware of the breach. A local authority's, building control department will seek to do so by informal means wherever possible. If informal enforcement does not achieve compliance with the regulations, the local authority may prosecute the person carrying out the work (the builder) in a magistrates' court where an unlimited fine may be imposed. Alternatively, or in addition, the local authority may serve an enforcement notice on the leaseholder, requiring alteration or removal of work which contravenes the regulations. If the owner does not comply with the notice, the local authority has the power to undertake the work itself and recover the costs of doing so from the owner.

When writing to leaseholders about any changes to the flat which do not comply with the relevant requirements of the Building Regulations, it is often useful to send a copy to the local authority for information.

The Fire Safety Order allows for enforcement action to be taken against an individual who the enforcing authority (the FRS authority for the area in which premises are situated) considers to be the most appropriate, which in some circumstances could be an individual leaseholder where ownership is demised to them.

Where a local FRS considers that the condition of the flat front door presents a risk to the safety of relevant persons, they can take action. Enforcement in such circumstances would usually commence with informal letters. Where no action is taken in response to the informal letters, or the matter is deemed to present a significant risk, a formal letter, the equivalent of an action plan, will be served. If the formal letter is not complied with, an enforcement notice can be issued. Failure to comply with an enforcement notice can result in prosecution.

Internal alterations to flats

For some blocks of flats, the internal layout of the flats is also designed to add to the compartmentation of the flats from common parts, e.g. protected lobbies. If leaseholders are making internal alterations to flats, then managing agents need to be aware and to prevent changes that add to the risk of fire and smoke spread.

Contractors working in flats may drill openings in fire-resisting walls without permission. It is essential that any new openings are made good to ensure the levels of fire containment are in no way reduced by such works.

Managing agents need to be vigilant against such possible changes to the fire risk in blocks and advise leaseholders carrying out internal alterations to let the agent know and to seek their advice before carrying out any internal alterations that could have an effect on fire safety in the block.

Leaseholders should, where possible, be suitably constrained from making detrimental changes by virtue of the conditions within their lease.

Examples of detrimental changes include:

- a leaseholder changing their flat entrance door, but not replacing it with a suitably fire-resisting and self-closing door;
- a resident installing a new bathroom suite, but not ensuring that breaches of riser walls created for new drains are fire-stopped afterwards to maintain fire separation to the common riser;
- a resident removing the doors and walls to the kitchen and lounge to create an open-plan living area, but in so doing making all the bedrooms inner rooms, and possibly impairing protection to the common parts;
- residents fitting non-condensing tumble dryers with holes through fire walls and doors for vent pipes;
- the installation of downlighters in the ceilings of flats that are not of a closed-back, 'fire-rated' design and which have not been fitted with intumescent fire hoods or covered by an insulation support box, therefore diminishing the fire separation provided by the ceiling; and
- a resident undertaking DIY to fit additional socket outlets and, in so doing, damaging the protection to the timber frame construction.

Wayfinding signage

In high-rise residential buildings, the Fire Safety (England) Regulations 2022 will, when they come into force on the 23rd January 2023, require responsible persons to install wayfinding signage in their buildings to assist the FRS in navigating their way round a building, even when visibility is low. This includes clear markings identifying floor and individual flat numbers.

Signage must conform to the specifications and location set out in paragraph 15.14 to 15.16 of Approved Document B Volume 1 2019 edition incorporating 2020 amendments.

Electric vehicle charging

Advances in technology and environmental concern have created an increasing demand for electric vehicles. While mobility scooters have been in common usage for many

years, many residential buildings now include facilities for parking and charging electric cars, electric motorcycles, electric bicycles and hybrid cars.

Electric vehicles:

- involved in a fire can release large volumes of smoke and generate significant heat; and
- when charged can introduce potential ignition hazards.

The risk associated with electric vehicle parking and charging must be considered in the building's FRA and appropriate controls implemented to address any risks identified.

Information on the safe charging of electric vehicles can be found in RISC Authority RC59: Recommendations for fire safety when charging electric vehicles²³.

Mobility scooters

The use of mobility scooters can enhance the quality of life for many older or less mobile residents. However, the charging and storage of mobility scooters in residential buildings, if not properly managed, can create fire safety risks.

In addition to the risks created by all electrical vehicles, mobility scooters:

- stored on escape routes and involved in a fire can make escape routes impassable; and
- stored outside and not in a secured compound give potential for deliberate ignition.

The risk associated with mobility scooters must be considered in the building's FRA and appropriate controls implemented to address any risks identified. Information on the safe use, storage and charging of mobility scooters in residential buildings can be found in the NFCC's Mobility Scooter Guidance for Residential Buildings¹⁹.

Housekeeping and common parts

The guidance on fire safety in purpose-built blocks of flats suggests two possible approaches to maintaining precautions in common parts: zero-tolerance or managed use.

A zero-tolerance approach is one in which residents are not permitted to use the common areas to store or dispose of their belongings or rubbish, with no exceptions. This may be the most straightforward policy to apply, but it may also be viewed as onerous and restrictive by occupants.

A managed use approach allows for strictly defined use of common areas with certain low-risk items to be present, e.g. pot plants and door mats. This may encourage occupants to foster a sense of pride and value in the block, and it may in turn lower the risk of antisocial behaviour. It can, however, be more difficult to adopt as it requires a clearly defined policy and regular inspection to ensure the list of items present does not grow such that it creates a risk of fire spread or obstruction in the means of escape.

Removal and disposal policy

It is for the responsible person to decide what the policy should be and ideally consult with the residents about what policy they want. It is much easier to achieve compliance with the support of the residents. Once the policy has been agreed, it should be widely publicised to all leaseholders and residents in the property. This should ideally include a written communication to each resident about the policy. The policy should also be publicised in newsletters and digital communication tools if they are used.

In both managed use and zero-tolerance, items creating an obstruction, may need to be removed. It is not lawful, however, even with a policy in place, to remove and immediately dispose of items.

The policy communication should explain the statutory duty placed upon the responsible person to keep fire escape routes clear so that they are always safe to use when required. Residents should be given a short period of time to remove their belongings, perhaps by posting a notice on the offending item. The published policy and any notices posted on goods should inform residents that any items not removed by the specified time and date will be put in storage, where they will be kept for a further period to allow the owners a further opportunity to collect them, before they are disposed of. In this way, some, and possibly the majority, of the items will be removed or collected by the residents.

Disposal of goods

The responsible person's obligations in relation to any goods that are not removed or collected, will depend on whether they are found to be a conventional or involuntary bailee.

Broadly, bailment is the transfer of possession (and not ownership) of goods by the owner (the bailor) to another person (the bailee) so that they might be used for a specified purpose on condition that they are:

- returned to the bailor; or
- kept until the bailor reclaims them.

An involuntary bailee is a bailment in which the bailee does not desire to take control over the bailed property. This typically occurs when a person inadvertently leaves goods on the property of the bailee.

Where the responsible person has indicated that it would store the goods for a period of time, there is an argument for suggesting that the responsible person in this type of situation is an involuntary bailee, because they did not initially consent to taking possession of the goods; rather, the goods were left in the communal parts without the responsible person's consent.

An involuntary bailee must not deliberately or recklessly damage or destroy the goods. Where items are not collected from storage, the objective is to try to minimise the risk of future legal challenge as far as possible. When deciding if, or when, to dispose of items that have not been collected, the task will be about managing or limiting the risk because it may not be possible to remove the risk altogether.

The Torts (Interference with Goods) Act 1977 permits the disposal of uncollected bailed goods; however, it is not clear whether originally involuntary bailments are within the scope of the legislation.

If it can be shown that items have been abandoned, the responsible person may be free to deal with those goods as they see fit. However, if the resident has not abandoned the goods, the retention and sale or disposal of the goods by the responsible person may give the true owner grounds for bringing a claim against the landlord for conversion. The tort of conversion occurs when one person interferes with the personal property of another, for example by taking it or withholding it without lawful justification. The difficulty will always be establishing that the goods have been abandoned.

The more time that passes, and the lower the likely value of the items, the less risk there will be of a possible challenge and the easier it is to argue that the items have been abandoned. The opposite is also true and, in such cases, the responsible person may wish to retain more valuable items for a longer period of time.

Managing agents should advise the responsible person to take legal advice before agreeing what action should be taken about goods that are not collected from storage.

Routine checks and maintenance

The Fire Safety (England) Regulations 2022 will, when they come into force on 23rd January 2023, impose a number of duties on responsible persons in relation to routine checking of fire doors, lifts and essential fire-fighting equipment.

A 'routine check' means a check, carried out in accordance with the relevant industry standard or any recommendations made by the manufacturers within a relevant manual, to ensure that any lift or piece of equipment is in efficient working order and in good repair.

Guidance will specify which pieces of equipment are subject to a visual inspection or other check, but it is not the intention of these regulations to require responsible persons to engage specialists to undertake these checks.

Essential firefighting equipment means:

- inlets for dry-rising mains;
- inlets for wet-rising mains;
- outlets for dry-rising mains;
- outlets for wet-rising mains;
- smoke control systems;
- suppression systems;
- fire detection and fire alarm systems including any detectors linked to ancillary equipment such as smoke control systems;
- EAS;
- automatic door release mechanisms linked to fire alarm systems;

In 'high-rise residential buildings', responsible persons will be required:

- to undertake monthly routine checks of:
 - o lifts for use by firefighters (firefighting lifts and firefighters' lifts);
 - o evacuation lifts; and
 - o essential fire-fighting equipment;
- where they identify any fault with a lift or piece of essential fire-fighting equipment, to:
 - o take steps to rectify the fault;
 - o where the identified fault cannot be rectified within a 24-hour period, must, as soon as reasonably practicable:
 - * report the fault to the local FRS by electronic means; and
 - * report the rectification of the fault to the local FRS by electronic means when it has been rectified;
- to make a record of the monthly checks undertaken and make that record accessible to the residents of the building.

Routine checks of fire doors

In residential buildings which contain two or more sets of domestic premises and which are above 11 metres in height, responsible persons will be required to:

- use best endeavours to undertake annual checks of flat entrance doors (including ensuring self-closing devices are working);
- keep a record of the steps taken to checks of flat entrance doors, and where access to the domestic premises was not granted during any 12-month period, the steps taken they have taken to try and gain access; and
- undertake checks of all fire doors (including ensuring self-closing devices are working) in communal areas of the building at least every 3 months.

The terms of the lease must be considered to establish where ownership lies in relation to the flat front doors.

If in doubt, the responsible person should take professional advice as to their duties and those of the leaseholders.

Maintenance

[Article 17](#) of the Fire Safety Order 2005, Maintenance, requires: ‘Where necessary in order to safeguard the safety of relevant persons the responsible person must ensure that the premises and any facilities, equipment and devices provided in respect of the premises under this Order ... are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair.’

It is essential for the safety of the occupants of a building that fire safety equipment and passive fire protection provisions are inspected, tested and maintained at appropriate intervals.

The responsibility for ensuring the regular testing and maintenance of these systems will usually lie with the responsible person and, where they have agreed to manage fire safety equipment, the managing agent [duty holders].

To comply with their legal duties, duty holders need to demonstrate that they have a structured and documented approach for meeting the functional requirements of the various articles of the Fire Safety Order (Articles 8, 11, 13, 14 and 17 being the most relevant).

Although there are no legally specified frequencies for maintenance, inspection and testing, managing agents are advised to comply with the requirements of the relevant British Standards for the individual fire safety installations.

Although the British Standards are guidance only, they represent best practice. Duty holders should only deviate from requirements of the relevant British Standards where it is recommended or approved by the fire risk assessor and recorded in the property’s FRA.

Equipment	Relevant standard	Inspection or testing					
		Daily	Weekly	Monthly	Quarterly	6 months	Annually
<ul style="list-style-type: none"> ✓ requirement for all buildings ✓ legal requirement for routine check of equipment in high-rise residential building ✓ legal requirement for residential building which is above 11 metres in height 							
Fire detection and fire alarm systems (including smoke detectors that activate automatic smoke vents in lobbies or protected staircases)	BS 5839-1:2017 – Fire detection and fire alarm systems for buildings. Code of practice for design, installation, commissioning and maintenance of systems in non-domestic premises. BS 5839-6:2019 – Fire detection and fire alarm systems for buildings. Code of practice for the design, installation, commissioning and maintenance of fire detection and fire alarm systems in domestic premises.	✓	✓	✓	✓	✓	
Evacuation alert system	The Fire Safety (England) Regulations 2022 BS 8629 Code of practice for the design, installation, commissioning and maintenance of evacuation alert systems for use by fire and rescue services in buildings containing flats			✓		✓	
Emergency lighting	BS 5266-1:2016 – Emergency lighting. Code of practice for the emergency lighting of premises.			✓			✓
Wet firefighting mains	The Fire Safety (England) Regulations 2022 BS 9990:2015 – Non-automatic firefighting systems in buildings. Code of practice.			✓		✓	✓

Equipment	Relevant standard	Inspection or testing					
		Daily	Weekly	Monthly	Quarterly	6 months	Annually
<ul style="list-style-type: none"> ✓ requirement for all buildings ✓ legal requirement for routine check of equipment in high-rise residential building ✓ legal requirement for residential building which is above 11 metres in height 							
Dry firefighting mains	The Fire Safety (England) Regulations 2022 BS 9990:2015 – Non-automatic firefighting systems in buildings. Code of practice.			✓		✓	✓
Fire sprinkler systems	The Fire Safety (England) Regulations 2022. BS 9251:2021 – Fire sprinkler systems for domestic and residential occupancies. Code of practice.			✓			✓
Watermist systems	The Fire Safety (England) Regulations 2022. BS 8458:2015 – Fixed fire protection systems. Residential and domestic watermist systems. Code of practice for design and installation.			✓			✓
Gaseous extinguishing systems	The Fire Safety (England) Regulations 2022. BS 5306-0:2020 – Fire protection installations and equipment on premises. Guide for selection of installed systems and other fire equipment. BS EN 15004-1:2019 – Fixed firefighting systems. Gas extinguishing systems. Design, installation and maintenance.		✓	✓			✓
Foam extinguishing systems	The Fire Safety (England) Regulations 2022. BS 5306-0:2020 – Fire protection installations and equipment on premises – Guide for selection, use and application of fixed firefighting systems and other types of fire equipment. BS EN 13565-2:2018 – Fixed firefighting systems. Foam systems – Design, construction and maintenance.			✓	✓	✓	✓
Powder extinguishing systems	The Fire Safety (England) Regulations 2022. BS 5306-0:2020 Fire protection installations and equipment on premises – Guide for selection, use and application of fixed firefighting systems and other types of fire equipment. BS EN 12416-2:2001 Fixed firefighting systems. Powder systems – Design, construction and maintenance.		✓	✓			✓

Equipment	Relevant standard	Inspection or testing					
		Daily	Weekly	Monthly	Quarterly	6 months	Annually
<ul style="list-style-type: none"> ✓ requirement for all buildings ✓ legal requirement for routine check of equipment in high-rise residential building ✓ legal requirement for residential building which is above 11 metres in height 							
Smoke control systems including automatic opening vents	<p>The Fire Safety (England) Regulations 2022 – Regulation 7.</p> <p>BS 7346-8:2013 – Components for smoke control systems – Code of practice for planning, design, installation, commissioning and maintenance.</p> <p>BS 9999:2017 – Fire safety in the design, management and use of buildings – Code of practice – Annex I.</p>		✓	✓	✓	✓	✓
Portable fire extinguishers	BS 5306-3:2017 – Fire extinguishing installations and equipment on premises. Commissioning and maintenance of portable fire extinguishers. Code of practice.			✓			✓
Hose reels	<p>BS 5306-0:2020 Fire protection installations and equipment on premises – Guide for selection, use and application of fixed firefighting systems and other types of fire equipment.</p> <p>BS 5306-1:2006 – Code of practice for fire extinguishing installations and equipment on premises – Hose reels and foam inlets.</p> <p>BS EN 671-3:2009 – Fixed firefighting systems. Hose systems. Maintenance of hose reels with semi-rigid hoses and hose systems with lay-flat hoses.</p> <p>Hose reels should be checked regularly to ensure that there are no leaks, the valves operate satisfactorily, the nozzle outlet is not choked and the nozzle can be moved from 'jet' to 'spray' position and vice versa without difficulty.</p>						✓
Fire hydrants	<p>BS 9990:2015 – Non-automatic firefighting systems in buildings. Code of practice.</p> <p>Periodic inspections of the vicinity of all hydrants should be made to ensure that there are no obstructions impeding accessibility and that hydrant indicator plates are in position.</p> <p>Periodic inspections should be made to ensure that all isolating valves for systems are kept locked in an open position. Also flow and pressure should be checked to ensure that supplies have not deteriorated.</p>						✓

Equipment	Relevant standard	Inspection or testing					
		Daily	Weekly	Monthly	Quarterly	6 months	Annually
<ul style="list-style-type: none"> ✓ requirement for all buildings ✓ legal requirement for routine check of equipment in high-rise residential building ✓ legal requirement for residential building which is above 11 metres in height 							
Firefighters lifts	<p>Lifting Operations and Lifting Equipment Regulations 1998 (LOLER).</p> <p>The Fire Safety (England) Regulations 2022 – Regulation 7.</p> <p>BS EN 81-72:2020 – Safety rules for the construction and installation of lifts. Particular applications for passenger and goods passenger lifts – Firefighters lifts.</p>		✓	✓		✓	✓
Fire evacuation lifts	<p>The Fire Safety (England) Regulations 2022 – Regulation 7</p> <p>Lifting Operations and Lifting Equipment Regulations 1998 (LOLER).</p> <p>BS EN 81-72:2020 – Safety rules for the construction and installation of lifts. Particular applications for passenger and goods passenger lifts – Firefighters lifts.</p> <p>BS 9999:2017 – Fire safety in the design, management and use of buildings. Code of practice – Annex I.</p>		✓	✓		✓	✓
Fire doors including automatic opening doors, emergency doors and panic escape doors	<p>The Fire Safety (England) Regulations 2022 – Regulation 10.</p> <p>BS 8214:2016 – Timber-based fire door assemblies. Code of practice.</p> <p>BS 9999:2017 – Fire safety in the design, management and use of buildings. Code of practice – Annex I.</p> <p>* on doors in the common parts.</p>		✓	✓ *✓		✓	✓
Fire door automatic release mechanisms	<p>The Fire Safety (England) Regulations 2022 – Regulation 10.</p> <p>BS 7273-4:2015+A1:2021 – Code of practice for the operation of fire protection measures. Actuation of release mechanisms for doors.</p> <p>This includes for acoustically actuated release mechanisms.</p> <p>* on doors in the common parts.</p>		✓	*✓	✓	✓	
Active fire curtain/barrier assemblies	<p>BS 8524-2:2013 – Active fire curtain barrier assemblies. Code of practice for application, installation and maintenance.</p> <p>* Where no sensory equipment is installed, check for obstructions to operational area.</p>	*✓	✓	✓	✓	✓	

BS 9991:2015 Fire safety in the design, management and use of residential buildings – Code of practice⁵⁶ indicates that the British Standards listed in the table below should be used for routine maintenance, inspection and testing of particular systems. The table also summarises the inspection frequencies required by the various standards.

The daily tests detailed in the table relate to the need to ensure that the systems and equipment listed remain in normal operation; that any fault is logged; and appropriate action is taken to remedy any defects. Remote monitoring of systems and equipment can, in many cases, be used to comply with this requirement.

All standards require the system designer/installer to ensure that the required maintenance, inspection and test requirements and frequencies are set out in the log book and operation and maintenance manual for the system.

Duty holders should consult the log book, which can be digital, and operation and maintenance manuals for all fire safety systems as these may include requirements for inspection and testing over and above the standards set out in the table above.

It is essential that both active and passive fire protection measures function in a fire. Duty holders must ensure that fire protection measures are inspected on a regular basis to ensure that they are available and functional at all times.

Inspections should ensure:

- escape routes are kept clear at all times;
- door locks, panic bars and automatic door release mechanisms are maintained so that they are easily openable in an emergency;
- the integrity of fire compartment walls or floors is maintained; and
- fire safety systems and equipment remain in normal operation, that any fault is logged, and appropriate action is taken to remedy any defects. Remote monitoring of systems and equipment can, in many cases, be used to comply with this requirement.

To ensure that faults are logged and action taken, managing agents may consider providing residents with a number to call for faults to be reported, logged and actioned.

All engineered fire safety solutions will be part of a cause-and-effect matrix which if operating correctly activates complementary systems. As such, these systems should be tested as a collective and not individually. By way of example, a weekly test of a fire alarm will also involve checking self-closing devices on fire doors, passenger lifts that should go to ground level with doors open, automatic opening vents that will open as required in the area of device activation, and other devices set to operate when the fire alarm sounds.

Fire doorsets should be examined for damage at regular intervals. The frequency of inspection should be determined as part of the FRA and be relative to the frequency of use of the doorway. For example, doors used infrequently might be programmed for monthly inspection; duct doors that are normally kept closed and might not be fitted with closers might be programmed for annual inspections; and high-use doors might be programmed for weekly inspections.

Although much of the inspection can be undertaken by suitably trained personnel, formal agreement should be made with suitably competent people or organisations to provide the regular inspection and testing described in the relevant British Standards for individual fire safety installations.

Records must be maintained of all inspections and tests; any defects must be logged along with details of any action taken. Certificates of testing must be obtained and maintained to provide evidence of action. Records should be maintained for at least five years.

Duty holders are advised to compile a fire safety manual for the fire systems in the building so these records are maintained in a central location for audit and inspection.

Details of the recommended structure and contents of the fire safety manual can be found in BS 9999:2017 – Fire safety in the design, management and use of buildings. Code of practice⁵⁸⁴ – Annex H.

Fire alarm testing

Where automatic fire detection is installed in common areas or working parts of the building (e.g. smoke detectors that activate automatic smoke vents in lobbies or protected staircases), then testing and maintenance is required in accordance with the relevant sections of BS 5839-1:2017 – Fire detection and fire alarm systems for buildings. Code of practice for design, installation, commissioning and maintenance of systems in non-domestic premises⁴³.

BS5839-1 makes the following statements

'Periodic inspection and servicing needs to be carried out by a competent person with specialist knowledge of fire detection and fire alarm systems, including knowledge of the causes of false alarms, sufficient information regarding the system, and adequate access to spares.'

'This is normally an outside fire alarm servicing organization; care needs to be taken to ensure that, if, for example, in-house employees are used for this task, they have equivalent competence to the technicians of a typical fire alarm servicing organization. Competence of a fire alarm servicing organization can be assured by the use of organizations that are third-party certificated, by a UKAS-accredited certification body, to carry out inspection and servicing of fire alarm systems.'

It is generally accepted that the weekly test can be somebody who has the skills, knowledge, experience and behaviours to carry out the test in accordance with the requirements of BS 5839-1.

All other tests and inspections should be done by 'suitably competent people or organisations' such as a fire alarm maintenance contractor.

Inspecting and maintaining fire doorsets

[Article 17](#) of the Fire Safety Order requires the responsible person to ensure that the premises and any facilities, equipment and devices provided in respect of the premises under this Order or, under any other enactment, which includes the Building Regulations, are subject to a suitable system of maintenance and are maintained in an efficient state, in efficient working order and in good repair. This duty clearly applies to fire doorsets.

The government's Fire Safety in Purpose-Built Blocks of Flats¹¹ indicates that it is good practice to inspect timber fire-resisting doorsets on a six-monthly basis as part of a programme of planned preventive maintenance to identify defects such as:

- missing or ineffective self-closing devices;
- damaged doors, frames or smoke seals/intumescent strips;
- removal of locks without suitable repairs to the integrity of the doors;
- poorly fitting doors caused by distortion or shrinkage, or as a result of wear and tear;
- newly fitted, but inappropriate, door furniture; and
- doors which have been replaced using non-fire-resisting types.

It also indicates that:

- flat entrance doors should be included within any risk assessment programme; and
- where defects are reported, it is important that action is taken within an appropriate timescale and that they are not simply left to the next six-monthly inspection.

BS 8214:2016 Timber-based fire door assemblies – Code of practice⁴⁸ notes that even when doors were compliant at the time of installation, they deteriorate over time and when they do will fail to provide the required level of protection. The two main forms of

deterioration are:

- damage to the door leaf, door frame or other components of the assembly; and
- wear in the door hardware or its fixings.

BS 8214:2016 notes the importance of inspection, maintenance and repair of any damage to fire doorsets and recommends that inspection and maintenance is undertaken on a regular basis to ensure that the required fire resistance is maintained.

BS 8214:2016 indicates that the frequency of inspection can be determined according to the risk assessment and relative to the frequency of use of the doorway but indicates that:

- doors used infrequently might be programmed for (say) monthly inspection;
- duct doors that are normally kept closed and might not be fitted with closers, can be omitted from the inspection programme; and
- high-usage doors could be programmed for (say) weekly inspections.

BS 8214:2016 also makes it clear that inspection and maintenance should be undertaken by a competent person.

Secure information box

When the Fire Safety (England) Regulations 2022 come into force on 23rd January 2023, responsible persons will, in high-rise residential buildings, be required, to install and maintain a secure information box in or on the building.

Secure information boxes are intended for use by the FRS during a fire. The information in the box allows first attending crews to be able to understand the layout of the building and to respond effectively through use of these plans in a dynamic environment without having to rely on technology.

The secure information box must:

- be:
 - o positioned at a location in or on the building which is readily accessible to the fire and rescue authority;
 - o capable of containing the documents that the regulations require it to contain;
 - o reasonably secure from unauthorised access and vandalism;
- contain:
 - o the name, address and telephone number within the United Kingdom of the responsible person;
 - o the name and contact information of such other persons within the United Kingdom who are provided with the facilities to and are permitted to access the building as the responsible person considers appropriate;
 - o a plan for each floor that must, together, identify the location of all lifts and identify if the lift is one for use by firefighters or an evacuation lift, and the key firefighting equipment in the whole building;
 - o a single-page building plan identifying the information set out earlier in regulation 6(4) of the Fire Safety (England) Regulations;
- be inspected at least annually to ensure that it continues to meet the requirements of the regulations.

Chapters 2-4 of the Code of Practice for the Provision of Premises Information Boxes in Residential Buildings²¹ sets out good practice on secure locations to install information boxes.

The Fire Safety (England) Regulations do not require a responsible person to include in the box any personal or sensitive information about residents.

In order to keep information safe and secure the box should be lockable. Access must be given to the FRS either by a copy of the key, or the access key-code, being shared with them.

Providing information to residents

The Fire Safety (England) Regulations 2022 will, when they come into force, require in buildings which contains two or more sets of domestic premises; and which contains common parts through which residents would need to evacuate in the case of an emergency to:

- display fire safety instructions in a conspicuous part of any building (such as the building's lobby); and
- provide the residents of the building with information about fire doors to the effect that:
 - o fire doors should be kept shut when not in use;
 - o residents or their guests should not tamper with the self-closing devices; and
 - o residents should report any faults or damage with doors immediately to the responsible person.

The fire safety instructions must be:

- in a comprehensible form that the residents can be reasonably expected to understand and include instructions:
 - o relating to the evacuation strategy for the building;
 - o about how to report a fire to the FRS authority; and
 - o about what residents must do when a fire has occurred.

After any material changes to the fire safety instructions, the displayed instructions must be replaced with the new instructions and a copy provided to residents.

Fire safety instructions and information about fire doors must be provided to:

- a new resident of domestic premises within the building, as soon as reasonably practicable after that resident moves into the premises; and
- all residents of domestic premises within the building within 12 months of the date the regulations come into force.

The regulations do not require fire safety instructions to be translated into multiple languages, but a responsible person is welcome to use their own discretion should they wish to do so. Relevant fire safety information is already available in alternative languages from some FRSs and can be downloaded from their websites.

Fire safety messages to leaseholders

The responsible person and managing agents, when their management agreement requires them to manage fire safety on the responsible person's behalf, have a duty to communicate important fire safety messages to leaseholders.

It is important that leaseholders understand their legal duties in relation to fire safety and in particular their duties in relation to the:

- maintenance or replacement of flat front doors where they form part of the building's fire compartmentation;
- replacement or removal of internal flat doors and any internal layout alterations;
- replacement of windows or the installation of security grilles or shutters; and
- installation of smoke detection devices.

Managing agents may use the 'ARMA leasehold advice note – Fire safety in flats' as a template for the provision of advice to leaseholders.

Managing agents may also wish to provide details of the fire strategy for the building in any guidance document they create, including, in particular, information on:

- the fire safety and emergency action plan for the block including an explanation of the Stay Put policy (where relevant), examples of which are included in Annex A;
- the required standard of housekeeping in common parts;
- security measures and requirements to prevent arson;
- the absence or presence of:
 - o fire detection and/or alarm systems;

-
- o firefighting equipment;
 - o fire suppression systems;
 - o smoke ventilation systems; and
 - a brief description of what any fire detection and/or alarm systems does.

Advice to leaseholders should be provided:

- at least annually;
- each time the FRA is updated and includes new information that may affect residents; and
- each time the ownership of the flat changes.

Managing agents should also consider communicating with leaseholders periodically to warn them of the fire safety risks and lease conditions connected with seasonal issues, such as the use of barbecues on balconies and Christmas lights.

Primary Authority Scheme

If a managing agent has premises in different fire authority areas, they can request a Primary Authority Scheme (PAS) partnership with a single fire authority in relation to regulatory compliance.

The aim of the PAS is for FRSs to develop effective partnerships with businesses that achieve national consistency in delivering fire safety enforcement and advice.

Once a managing agent is in a partnership with a fire authority, the authority becomes the single point of contact for fire safety regulation advice. The regulatory advice will therefore be consistent across a managing agent's portfolio.

A Primary Authority is entitled to recover its costs for developing and providing Primary Authority advice and for other work it does to support a partnership under the scheme. However, it is not able to make a profit from these activities. This means that the cost of joining the scheme is completely dependent on how much work is done within the partnership. It can be helpful for a managing agent and authority to get together and map out what work might be needed and to ask the local authority for an estimate of likely costs.

If an FRS has concerns about how a business that has a PAS with a different FRS is complying with fire safety regulations, it will discuss the issue with the Primary Authority at an early stage.

If an FRS believes that there is a statutory requirement for taking enforcement action, it must notify the Primary Authority of the action it proposes to take. However, in some cases there will be a need for enforcement action to proceed immediately, for example where action is needed urgently to ensure the safety of employees or members of the public.

Where actions of a business are potentially subject to enforcement action by an FRS, the business's Primary Authority will advise the FRS on whether it has given the relevant fire safety advice to the business and whether the enforcement action being proposed is consistent with that advice.

If there is disagreement over whether proposed enforcement action is consistent with the advice given by the Primary Authority, the Better Regulation Delivery Office is empowered to determine what, if any, action should be taken.

The PAS is open to any business, charity or other organisation that is regulated by two or more FRSs under the Fire Safety Order. The managing agent can choose which FRS to enter into a PAS with; it does not have to be the one nearest to the head office or in the county where the managing agent has the greatest number of outlets.

A PAS is a partnership arrangement; the managing agent should therefore take time to ensure that the FRS they choose to partner with is right for their business. It might be

worth the managing agent considering whether they already have a close relationship with a particular fire authority that is working well. Location might be important too: some partnerships find that regular face-to-face meetings or site visits are important, while for others this is not a significant issue.

A partnership is legally recognised under the Primary Authority once a local authority is nominated by the Secretary of State as the Primary Authority for a managing agent's business.

An application for nomination is initiated by the fire authority that is going to partner with the business via the secure Primary Authority Register. The managing agent then receives a link to the application and completes it, submitting it to Regulatory Delivery. Both the local authority and the business are required to accept the Primary Authority Terms and Conditions.

Further information

Legislation

1. [Fire Safety Act 2021](#)
2. [Building Safety Act 2022](#)
3. [The Regulatory Reform \(Fire Safety\) Order 2005](#)
4. [The Fire Safety \(England\) Regulations 2022](#)
5. [The Building Regulations 2010](#)
6. [The Housing Act 2004](#)
7. [Landlord and Tenant Act 1985](#)

Guidance

8. [Home Office: Fire Safety Act Commencement Prioritisation Guidance](#)
9. [Government: Fire Risk Assessment Prioritisation Tool](#)
10. [Government Fire Safety \(England\) Regulations 2022 Factsheets](#)
11. [Fire safety in purpose-built blocks of flats](#)
This document is a guide to ensuring adequate fire safety in purpose-built blocks of flats, regardless of age. Practical advice is offered on how to assess the risk from fire and how to manage fire safety in such buildings. The document also includes case studies based on common issues in blocks of flats, with suggested fire safety solutions.

It was produced in 2011 and summarised the legislation, guidance and best practice at the time of writing and should be viewed as no longer comprehensive. The Home Office is currently working on a revised version of this guide. In the interim, it is continued to be made available to fire safety professionals as it contains relevant and useful information for purpose-built blocks of flats.
12. [LACoRS – Housing – Fire safety: Guidance on fire safety provisions for certain types of existing housing](#)
NB: Caution is required when using this document because some information is now out of date.
13. [Building Regulations Approved Document B Volume 1: Dwellings 2019 edition incorporating 2020 amendments – for use in England](#)
14. [Building Regulations Approved Document B Volume 2: Buildings other than dwelling houses](#)
15. [NFCC Guidance to support a temporary change to a Simultaneous Evacuation strategy in purpose-built blocks of flats](#)
16. [NFCC Stay Put position statement](#)
17. [NFCC Fire safety risk assessment guidance](#)
18. [NFCC High-rise safety for residents](#)
19. [NFCC Mobility Scooter Guidance for Residential Buildings](#)
20. [NFCC Guidance: Reduction of False Alarms and Unwanted Fire Signals](#)
21. [NFCC and FIA Guide: Code of Practice for the Provision of Premises Information Boxes in Residential Buildings](#)
22. [RISCAuthority RC07: Recommendations for Hot Work](#)

-
23. [RISCAuthority RC59: Recommendations for fire safety when charging electric vehicles](#)
 24. [CFOA – Collected perceived insights into and application of the Regulatory Reform \(Fire Safety\) Order 2005 for the benefit of enforcing authorities – 2015 \[Enforcers Guide\] revision14](#)
 25. [Fire Sector Federation – Approved Code of Practice for Fire Risk Assessor Competency](#)
 26. [Fire Sector Federation – A Guide to Choosing a Competent Fire Risk Assessor](#)
 27. [Fire Industry Association: The Status of PAS 79-2 & LGA Fire safety in purpose-built blocks of flats guide](#)

Organisations

28. [The Institute of Fire Safety Managers](#)
29. [The Institute of Fire Prevention Officers](#)
30. [The Institution of Fire Engineers](#)
31. [National Fire Chiefs Council \(NFCC\)](#)
32. [UKAS](#)
33. [Professional Engineering Institutions](#)
34. [Engineering Council \(EngC\)](#)
35. [Bluesky Certification](#)

British Standards

36. [PAS 79-2 – Fire risk assessment – Part 2: Housing – Code of practice](#)
37. [BS EN 1154:1997 – Building hardware. Controlled door closing devices. Requirements and test methods \(under review\)](#)
38. [BS EN 1935 – Building hardware. Single-axis hinges. Requirements and test methods \(under review\)](#)
39. [BS 5266-1:2016 – Emergency lighting. Code of practice for the emergency lighting of premises](#)
40. [BS 5306-0:2011 – Fire protection installations and equipment on premises. Guide for selection of installed systems and other fire equipment](#)
41. [BS 5306-1:2006 – Code of practice for hose reels and foam inlet installations and fire equipment on premises](#)
42. [BS 5306-3:2017 – Fire extinguishing installations and equipment on premises. Commissioning and maintenance of portable fire extinguishers. Code of practice](#)
43. [BS 5839-1:2017 – Fire detection and fire alarm systems for buildings. Code of practice for design, installation, commissioning and maintenance of systems in non-domestic premises \(under review\)](#)
44. [BS 5839-6:2013 – Fire detection and fire alarm systems for buildings. Code of practice for the design, installation, commissioning and maintenance of fire detection and fire alarm systems in domestic premises](#)
45. [BS 7273-4:2015 – Code of practice for the operation of fire protection measures. Actuation of release mechanisms for doors](#)
46. [BS 7346-8:2013 – Components for smoke control systems. Code of practice for planning, design, installation, commissioning and maintenance](#)
47. [BS7974:2019 – Application of fire safety engineering principles to the design of buildings. Code of practice](#)
48. [BS 8214:2016 – Timber-based fire door assemblies. Code of practice](#)
49. [BS 8458:2015 – Fixed fire protection systems. Residential and domestic watermist systems. Code of practice for design and installation](#)
50. [BS 8524-2:2013 – Active fire curtain barrier assemblies. Code of practice for application, installation and maintenance](#)
51. [BS 8629 – Code of practice for the design, installation, commissioning and maintenance of evacuation alert systems for use by fire and rescue services in buildings containing flats](#)
52. [BS 8644-1 – Digital management of fire safety information. Part 1: Design, construction, handover, asset management and emergency response – Code of practice](#)
53. [BS 9251:2014 – Fire sprinkler systems for domestic and residential occupancies. Code of practice](#)
54. [PAS 9980:2022 – Fire risk appraisal of external wall construction and cladding of existing blocks of flats. Code practice](#)

55. [BS 9990:2015 – Non-automatic firefighting systems in buildings. Code of practice](#)
56. [BS 9991:2015 – Fire safety in the design, management and use of residential buildings. Code of Practice \(current, under review\)](#)
57. [BS 9997:2019 – Fire Risk Management Systems – Requirements with guidance for use](#)
58. [BS 9999:2017 – Fire safety in the design, management and use of buildings. Code of practice \(current, under review\)](#)
59. [BS EN 12416-2 – Fixed firefighting systems – Powder systems – Part 2: Design, construction and maintenance](#)
60. [BS EN 13565-2 – Fixed firefighting systems – Foam systems – Part 2: Design, construction and maintenance](#)
61. [BS EN 15004-1:2019 – Fixed firefighting systems. Gas extinguishing systems. Design, installation and maintenance](#)
62. [BS EN 81-72:2020 – Safety rules for the construction and installation of lifts. Particular applications for passenger and goods passenger lifts – Firefighters lifts](#)
63. [BS EN 671-3:2009 – Fixed firefighting systems. Hose systems. Maintenance of hose reels with semi-rigid hoses and hose systems with lay-flat hoses.](#)

Royal Institution of Chartered Surveyors

64. [Form EWS1: External Wall Fire Review](#)
65. [EWS Form – List of Relevant Professional Bodies](#)
66. [Cladding for surveyors. Supplementary information paper](#)



**The Association of Residential
Managing Agents Ltd**
3rd Floor, 2-4 St George's Road
London
SW19 4DP

Tel 020 7978 2607
info@arma.org.uk
www.arma.org.uk

**PRIMARY
AUTHORITY**

Important note to reader:

This document has been produced by the ASSOCIATION OF RESIDENTIAL MANAGING AGENTS (ARMA – Now part of The Property Institute) in line with statutory guidance and industry best practice and independently reviewed and endorsed by Hampshire Fire and Rescue Service who are ARMA's Primary Authority Partner.

Guidance Notes (GN), which may be updated from time to time, are produced for the use of members only; they should not be distributed to third parties unless the particular GN has a note to that effect.

Whilst every effort has been made to ensure the accuracy of the information contained in this GN, it must be emphasised that because the Association has no control over the precise circumstances in which it will be used, the Association, its officers, employees and members can accept no liability arising out of its use, whether by members of the Association or otherwise. The GN is of a general nature only and makes no attempt to state or conform to legal requirements; compliance with these must be the individual user's own responsibility and therefore should seek independent advice.

Annex A – Examples of fire action notices

Example of notice for use in blocks with a Stay Put policy

The following guidance needs to be modified to suit the fire safety arrangements in individual properties. Your block of flats has been designed to support a Stay Put strategy.

The Stay Put principle has underpinned fire safety design standards since before the 1960s, when national standards were first drafted. It is still the basis upon which blocks of flats are designed today.

The National Fire Chiefs Council (NFCC) ‘supports the principle of a Stay Put strategy whenever possible. The Stay Put strategy has been proved over many years to be safe for residents of purpose-built blocks of flats. The NFCC believes that a Stay Put strategy is the correct advice in a purpose-built block of flats that is built and maintained correctly.’

Chair of the NFCC, Roy Wilsher, has stated: ‘If you leave your flat you could be rushing into choking smoke, the fire itself or firefighters using equipment to bring the fire under control. If the fire, heat or smoke is affecting you directly or you are in the communal areas of the building, get out, stay out and call 999. The most important thing you can do is to know your plan in the event of a fire. Make sure you have working smoke alarms, test them regularly, and ask your landlord what strategy is in place in your building.’

If fire breaks out in your home:

- When a fire occurs within your flat, you should alert others in the flat and make your way out of the building and call the fire and rescue service.
- If it is safe to do so, close windows and internal doors.
- Always close the front door of your flat behind you.
- All other residents not directly affected by the fire would be expected to Stay Put and remain in their flat unless directed to leave by the fire and rescue service.
- This does not preclude those evacuating a flat that is on fire from alerting their neighbours so that they can also escape if they feel threatened.
- Wait outside, away from the building, until instructed to return by the fire and rescue service.

If you see or hear of a fire in another part of the building:

- If you become aware of a fire in the common parts or another flat, you should make your way out of the building and call the fire and rescue service.
- This does not preclude you from alerting others in the vicinity of the fire so that they can also escape if they feel threatened. If it is safe to do so, you should leave your home if smoke or heat affects it.

To call the fire service:

- Dial 999.
- When the operator answers, give your telephone number and ask for FIRE.
- When the fire service replies, give the address where the fire is.
- Do not end the call until the fire service has repeated the address correctly.

Example of notice for use in blocks with a Simultaneous Evacuation policy

This building operates a Simultaneous Evacuation policy.

If fire breaks out in your home:

- Leave the room where the fire is straight away, then close the door.
- Tell everyone in your home and get them to leave.
- Close windows, doors and the front door of your flat behind you.
- Do not stay behind to put the fire out.
- Raise the alarm by using a ‘break glass’ call point (if installed as part of the alarm system).
- Call the fire service.
- Wait outside, away from the building.

If you see or hear of a fire in another part of the building:

- The evacuation plan for this building requires all residents to proceed to the assembly point when the communal fire detection and alarm system sounds.
- You must also leave IMMEDIATELY if smoke or heat affects your home, or if you are told to do so by the fire service.
- If you are in any doubt, and it is safe to do so, get out.

To call the fire service:

- Dial 999.
- When the operator answers, give your telephone number and ask for FIRE.
- When the fire service replies, give the address where the fire is.
- Do not end the call until the fire service has repeated the address correctly.

Annex B – Advice on the scope of a FRA

Any person involved in the commissioning of a fire risk assessment (FRA) or fire risk assessment review should consult the Home Office's Fire Safety Act Commencement Prioritisation Guidance which was published in May 2022⁷.

When conducting a Fire Risk Appraisal of the External Wall (FRAEW), current best practice is set out in PAS 9980:2022 – Fire risk appraisal and assessment of external wall construction of existing blocks of flats – Code of practice⁵⁴.

When considering the scope of an FRA of the structure of the buildings with two or more sets of domestic premises and parts in the buildings that are used in common by the occupants of more than one such dwelling, the following guidance on the scope of the assessment may be helpful.

Types of assessment

Fire safety in purpose-built flats provides some detailed descriptions of the varying degrees of invasiveness and detail required for FRAs, as follows:

Type 1 – Common parts only (non-destructive)

A Type 1 FRA is the basic FRA required for the purpose of satisfying the Fire Safety Order.

The inspection of the building is non-destructive. But, as well as considering the arrangements for means of escape and so forth, the FRA includes examination of at least a sample of flat entrance doors. It also considers, so far as is reasonably practicable, the separating construction between the flats and the common parts without any opening up of the construction. However, in this type of FRA, entry to flats beyond the area of the flat entrance door is not required.

Where there are demountable false ceilings in the common parts, it may be appropriate to lift a sample of readily accessible false ceiling tiles. In addition, it will normally be appropriate to open a sample of service risers, provided access is practicable at the time of inspection.

Unless there is reason to expect serious deficiencies in structural fire protection – such as inadequate compartmentation or poor fire stopping – a Type 1 inspection will normally be sufficient for most blocks of purpose-built flats. Where doubt exists in relation to these matters, the action plan of a Type 1 FRA may recommend that one of the other types of FRA be carried out or that further investigation be done by specialists. However, this should not be a generic recommendation of all Type 1 FRAs; the recommendation should be based on identification of issues that justify reason for doubt.

Type 2 – Common parts only (destructive)

The scope and objectives of a Type 2 FRA are generally similar to those of a Type 1 FRA, except that there is a degree of destructive inspection, carried out on a sampling basis. This will usually necessitate the presence of a contractor for the purpose of opening up construction and making good after the inspection.

In order to check the integrity of separating constructions, the areas in which destructive inspection is carried out might sometimes include a sample of flats. However, because of the nature of the work, this can often only be carried out in vacant flats.

A Type 2 FRA is usually a one-off exercise that is carried out only if there is good reason to suspect serious structural deficiencies that could lead to spread of fire beyond the flat of fire origin. The age of the block alone is not generally sufficient to warrant a Type 2 inspection. The need for a Type 2 FRA may sometimes be identified in a Type 1 FRA, but should not simply be recommended as a matter of course.

Type 3 – Common parts and flats (non-destructive)

A Type 3 FRA includes the work involved in a Type 1 FRA, but goes beyond the scope of the Fire Safety Order (though not the scope of the Housing Act). This FRA considers the arrangements for means of escape and fire detection (i.e. smoke alarms) within at least a sample of the flats. Within the flats, the inspection is non-destructive, but the fire resistance of doors to rooms is considered.

Measures to prevent fire, such as maintenance of the electrical and heating installations, are not considered unless the measures are within the control of, for example, the landlord.

A Type 3 FRA may sometimes be appropriate for rented flats if there is reason to suspect serious risk to residents in the event of a fire in their flats. This might be, for example, because of the age of the block or reason for suspicion of widespread, unauthorised material alterations.

Type 4 – Common parts and flats (destructive)

A Type 4 FRA has the same scope of work as a Type 3 FRA, except that there is a degree of destructive inspection, in both the common parts and the flats, carried out on a sampling basis. This will usually necessitate the presence of a contractor for the purpose of opening up constructions and making good after the inspection. However, the nature of the work is such that, often, destructive inspection within flats can only be carried out in those that are vacant.

This is the most comprehensive FRA, but will only be appropriate in limited circumstances, such as when a new landlord takes over a block of flats in which the history of works carried out is unknown and there is reason to suspect serious risk to residents from both a fire in their own flats and a fire in neighbours' flats.

Note: Before destructive inspection is to be carried out, the risk of disturbing asbestos should be considered (See ARMA Guidance Note B03 Asbestos Management).

Annex C – Fire Design Standards

Non-residential buildings are usually designed in accordance with:

- British Standard Code of Practice, CP3 Code of Basic Data for the Design of Buildings;
- Approved Document B Volume 2: Buildings other than dwellings; or
- BS 9999:2017 - Fire safety in the design, management and use of buildings - Code of practice (under review).

Residential buildings are usually designed in accordance with:

- British Standard Code of Practice, CP3 Code of Basic Data for the Design of Buildings;
- Approved Document B volume 1: Dwellings (including blocks of flats); or
- BS 9991:2015 - Fire safety in the design, management and use of residential buildings - Code of practice (under review).

Fire engineering principals can apply to support alternative solutions where strict adherence to the codes may conflict wider aspirations for the scheme through the application of BS 7974:2019 47 Parts 1 to 7.

Details of the code that has been used and any variations from code compliance should be documented in the fire strategy.

All buildings to which the Regulatory Reform (Fire Safety) Order 2005 applies must comply with the requirements of the Order including taking measures:

- to reduce the risk of fire on the premises and the risk of the spread of fire on the premises;
- in relation to the means of escape from the premises;
- for securing that, at all material times, the means of escape can be safely and effectively used;
- in relation to the means for fighting fires on the premises;
- in relation to the means for detecting fire on the premises and giving warning in case of fire on the premises; and
- in relation to the arrangements for action to be taken in the event of fire on the premises, including measures to mitigate the effects of the fire.

Annex D - The History of Building Regulations

In 1666 the Rebuilding of London Act was passed in response to the Great Fire of London. It determined that street widths, as well as the heights of houses, were regulated and brick construction was prescribed. Timber-framed buildings were forbidden and projections or jetties over the streets were prohibited because they allowed fire to leap from house to house.

The Fires Prevention (Metropolis) Act 1774 was passed to consolidate earlier fire safety legislation and to regulate the design and construction of new buildings in London.

The Public Health Act 1936 required local authorities outside of London to make local building byelaws to ensure adequate means of escape from blocks of flats over two storeys and with a floor over 20 foot (ft) above ground level.

Until 1948 when British Standard Code of Practice, CP3 Code of Basic Data for the Design of Buildings was published, none of the legislation made specific detailed requirements for the design of measures. Chapter IV of CP3 set out the functional requirements for 'Precautions against Fire' in 'Houses and flats of not more than two storeys'. The introduction to the code notes that 'houses and flats with a basement or roof space which is used as habitable accommodation are not within the scope of the recommendations in this Chapter but will be covered in the full chapter for all classes of buildings'.

The Public Health Act 1936 was amended by the Public Health Act 1961 to permit the making of one set of national building regulations.

In 1962, British Standard Code of Practice, CP3 IV Part 1 was published which provided covered 'flats and maisonettes (in blocks over two storeys)'. It was CP3 chapter IV Part 1 that first introduced the 'stay put' strategy although it was noted in the guidance that: 'the possibility that individuals may seek to leave the building cannot be overlooked and provision should therefore be made for the occupant of any dwelling to do so by his own unaided efforts, using adequately protected escape routes within the building without outside assistance.' Because, as the document notes, 'there is no reason for a substantially different Code of Practice applying to buildings below 24 m (approximately 80 ft) in height, compared with those above 24 m (approximately 80 ft) in height, CP3 IV Part 1 applied to all flats and maisonettes above the first floor in blocks of any height.

The first set of national building standards were introduced in the Building Regulations 1965. These were a set of prescriptive standards that had to be followed. Part E of the regulations covered structural fire precautions. The design requirements that supported the stay put principal were set out in paragraph 5 of part E5 Fire Resistance.

CP3 IV Part 1 was revised in 1971.

The Building Act 1984 brought fundamental changes to the building regulations regime. It introduced:

- functional performance standards, set in terms of what was adequate, reasonable or appropriate, supported by statutory guidance in the Approved Documents;
- competition into the building control sector through the addition of private sector approved inspectors.

Buildings have therefore, for many years, been designed to meet fire safety standards.